

TO:

PROJECT:

PROJECT LOCATION:

SPECIFIED ITEM:

Section	Page	Paragraph	Description
---------	------	-----------	-------------

PRODUCT SUBMITTAL / SUBSTITUTION REQUESTED

Aerosmith[®] Sure-Set[®] PE-10 and PE-21 Plus+ Pure Epoxy

The attached submittal package includes the product description, specifications, drawings, and performance data for use in the evaluation of the request.

SUBMITTED BY:

Name:

Signature:

Company:

Address:

Date:

Telephone:

Fax:

FOR USE BY THE ARCHITECT AND/OR ENGINEER

☐

Approved

☐

Approved as Noted

☐

Not Approved

(If not approved, please briefly explain why the product was not accepted.)

By:

Date:

Remarks:

Sure-Set® PE-10 and PE-21 Plus+ Pure Epoxy

Home » Products » Adhesive Anchoring » Sure-Set® PE-10 and PE-21 Plus+ Pure Epoxy



Manufactured in the USA · BABA: *Buy America, Build America*



Sure-Set® Plus+ Pure Epoxy

At Aerosmith® Fastening Systems, your health and safety on the construction site, is job one. That's why we ensure that all the adhesives we sell carry the highly recognized ICC-ES and Iampro Certified Approvals. What this means is that these products have gone through extensive and rigorous testing to not only ensure product quality, but more importantly when used appropriately, perform as intended with your safety and the safety of others at the forefront.

With that in mind, Aerosmith® is pleased to introduce its new line of Sure-Set® Plus+ Pure Epoxy adhesive anchoring.

Product Information:

The PE-10 Plus+/PE-21 Plus+ is an injectable two component epoxy adhesive. The two components are kept separately by means of a labeled dual cylinder cartridge. The two components combine and react when dispensed through a static mixing nozzle supplied by Aerosmith Fastening Systems, which comes attached to each cartridge. Product is available in a 9.5- and 20.5- fluid ounce cartridge. This high-performance adhesive may be used in combination with a Manual, Battery or Pneumatic Dispensing Tool. It was specifically designed for the anchoring of threaded rods and reinforcing bars into Normal and Light weight concrete, brick, block and stone.


Tested and approved for use in **CRACKED CONCRETE, UNCRACKED CONCRETE, Category 1**

Applications:

- Structural applications in cracked and uncracked concrete
- Pinning building façades
- Post installed rebar connections
- Crash barriers
- The attachment of structural steel to concrete
- Railings
- Signage
- Rebar doweling
- Sill plate attachments: suitable for horizontal, vertical and overhead anchoring applications.
- Cable trays
- Lighting Stanchions
- Conveyors
- Racking

Base Material:

- Concrete
- Solid rock
- Hard natural stone
- Solid masonry

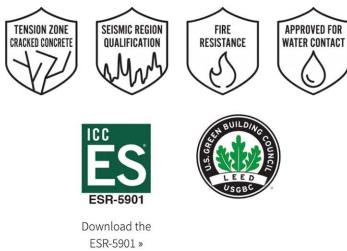

Important Information:

- ICC-ES Evaluated ESR-5901
- Two year shelf life when stored properly
- Certificated through WQA's Gold Seal program for drinking water system components
- For heavy anchoring and post-installed rebar connection
- Seismic rated
- Can be applied in dry, wet, submerged concrete or water filled bore holes
- High chemical resistance
- Low odor
- High bending and pressure strength
- Cartridge can be reused up to the end of the shelf life by either replacing the static mixer or resealing cartridge with the sealing cap

Approvals and Listing:

ICC-ES ESR-5901 Cracked and Uncracked Concrete Category 1
Code Compliant IBC Listed (International Building Code)
Code Compliant IRC Listed (International Residential Code)
Code Compliant FBC Listed (Florida Building Code)
Code Compliant FRC Listed (Florida Residential Code)
Code Compliant COLA Listed (City of Los Angeles)
Tested in accordance with AC308 and AC58 for use in structural concrete and masonry

Technical Data:



Installation Instructions:

Drilling

Precaution: Wear suitable eye and skin protection. Avoid inhalation of dust during drilling and/or removal.

1. Drill a hole into the base material with an electric or battery-operated hammer drill to the size and embedment required by the selected steel hardware element. The tolerances of the carbide drill bit must meet the requirements of ANSI Standard B212.15.
2. Starting from the bottom or back of the anchor hole, blow the hole clean with either compressed air (min. 6 bar / 90 psi) a minimum of two times, until return air stream is free of noticeable dust. If the back of the drilled hole is not reached an extension shall be used or with a blowout bulb or canister.
- 2b. Determine brush diameter for the drilled hole. Brush the hole with the selected wire brush a minimum of two times (2x). A brush extension (supplied by Aerosmith Fastening) must be used for drill hole depth > 6" (150 mm). The brush should resist insertion into the drilled hole - if not the brush is too small and must be replaced with the proper brush diameter. If the back of the drilled hole is not reached a brush extension shall be used.
- 2c. Finally blow the hole clean again with compressed air (min. 6 bar / 90 psi) or blow out bulb or cannister a minimum of two times, until return air stream is free of noticeable dust. If the back of the drilled hole is not reached an extension shall be used. When finished the hole should be clean and free of dust, debris, ice, grease, oil or other foreign material.
3. Check adhesive expiration date on cartridge label. Do not use Expired Product. Review Safety Data Sheet (SDS) before use. For the permitted range of the base material and cartridge temperature see ESR-5901 or cartridge label. Attach a supplied mixing nozzle to the cartridge. Do not modify the mixer in any way and make sure the mixing element is inside the nozzle. Load the cartridge into the correct dispensing tool.
- Note: Always use a new mixing nozzle with new cartridges of adhesive and also for all work interruptions exceeding the published gel (working) time of the adhesive.
4. Prior to inserting the anchor rod or rebar into the filled drilled hole, the position of the embedment depth has to be marked on the anchor. Verify anchor element is straight and free of surface damage.
5. Adhesive must be properly mixed to achieve published properties. Prior to dispensing adhesive into the drilled hole, separately dispense at least three full strokes of adhesive through the mixing nozzle until the adhesive is a consistent gray color. Review and note the published working and cure times in ESR 5901 or on cartridge label. prior to injection of the mixed adhesive into the cleaned anchor hole.
6. Fill the cleaned hole approximately two-thirds full of mixed adhesive starting from the bottom or back of the anchor hole. Slowly withdraw the mixing nozzle as the hole fills to avoid creating air pockets or voids. If the bottom or back of the anchor hole is not reached with the mixing nozzle only an extension tube supplied by Aerosmith Fastening must be used with the mixing nozzle.
- In case of using the extension tube VL16/1,8 (Cat# 16004), cut the tip of the mixer nozzle at position "X". Piston plugs must be used with and attached to mixing nozzle and extension tube for:
 - overhead installations and installations between horizontal and overhead
 - all installations with drill hole depth d0 > 10" (250 mm)
 - all installations in submerged bore holes with anchor rod 5/8" to 1-1/4" (M16 to M30) diameter and rebar sizes #5 to #11 (Ø14 to Ø36)
- Insert piston plug to the back of the drilled hole and inject as described in the method above. During installation the piston plug will be naturally extruded from the drilled hole by the adhesive pressure.
- Attention! Do not install anchors overhead or upwardly inclined without installation hardware supplied by Aerosmith Fastening and also receiving proper training and/or certification. Contact Aerosmith Fastening for details prior to use.
7. The anchor should be free of dirt, grease, oil or other foreign material. Push clean threaded rod or reinforcing bar into the anchor hole while turning slightly to ensure positive distribution of the adhesive until the embedment depth is reached. Observe the gel (working) time.
8. Be sure that the anchor is fully seated at the bottom of the hole and that some adhesive has flowed from the hole and all around the top of the anchor. If there is not enough adhesive in the hole, the installation must be repeated. For overhead applications and applications between horizontal and overhead the anchor must be secured from moving/falling during the cure time (e.g. wedges). Minor adjustments to the anchor may be performed during the gel time but the anchor shall not be moved after placement and during cure.
9. Allow the adhesive anchor to cure to the specified full curing time prior to applying any load. Do not disturb, torque or load the anchor until it is fully cured.
10. After full curing the adhesive anchor, a fixture can be installed to the anchor and tightened up to the maximum torque by using a calibrated torque wrench. Take care not to exceed the maximum torque for the selected anchor.

Aerosmith® Sure-Set® Plus+ Pure Epoxy

Part ID	Product	Cartridge size	Carton Qty.
Sure-Set PE-10 Plus+	Sure-Set® Plus+ PE-10	10 oz (8.5 fluid ounces)	12
Sure-Set PE-21 Plus+	Sure-Set® Plus+ PE-21	21 oz (21 fluid ounces)	12



Established over 50 years ago, Aerosmith® Fastening Systems continues to be a leader in developing hardened steel pins & specialty tools for today's unique application challenges, including plywood, Hardie, and track to steel and concrete applications. Our expertise has led to numerous patents for fasteners, as well as tools (nailers, nail guns, etc.).

Construction, Industrial/OEM, and Specialty users benefit from Aerosmith® systems by saving time, money, and manpower! Headquartered in Indianapolis, Indiana, Aerosmith® is able and positioned to serve both the United States and a Worldwide Market!

Contact Aerosmith® HQ

Address:
5621 Dividend Road
Indianapolis, Indiana 46241

Phone:
P: 844.373.2666
F: 914.817.0168

Follow: [f](#) [t](#) [i](#) [d](#) [in](#)

Disclaimer | Privacy Policy | Terms and Conditions

ICC-ES Evaluation Report

ESR-5901

Issued February 2026

This report also contains:

- [City of LA Supplement](#)

Subject to renewal February 2027

- [CA Supplement](#)

- [FL Supplement w/HVHZ](#)

ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.

Copyright © 2026 ICC Evaluation Service, LLC. All rights reserved.

DIVISION: 03 00 00— CONCRETE Section: 03 16 00— Concrete Anchors DIVISION: 05 00 00— METALS Section: 05 05 19— Post-Installed Concrete Anchors	REPORT HOLDER: AEROSMITH FASTENING SYSTEMS 	EVALUATION SUBJECT: AEROSMITH SURE-SET® PURE EPOXY PLUS+ ADHESIVE ANCHOR AND POST-INSTALLED REINFORCING BAR CONNECTION SYSTEM IN CRACKED AND UNCRACKED CONCRETE	
--	---	--	---

1.0 EVALUATION SCOPE

Compliance with the following codes:

- 2024, 2021, 2018, and 2015 [International Building Code® \(IBC\)](#)
- 2024, 2021, 2018, and 2015 [International Residential Code® \(IRC\)](#)

Main references of this report are for the 2024 IBC and IRC. See [Table 22](#) and [Table 23](#) for applicable sections of the code for previous IBC and IRC editions

Property evaluated:

Structural

2.0 USES

Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive anchor system is used as anchorage to resist static, wind or earthquake (IBC Seismic Design Categories A through F) tension and shear loads in cracked and uncracked normal-weight and lightweight concrete with $\frac{3}{8}$ -, $\frac{1}{2}$ -, $\frac{5}{8}$ -, $\frac{3}{4}$ -, $\frac{7}{8}$ -, 1-, and $1\frac{1}{4}$ -inch fractional diameter, and M10, M12, M16, M20, M24, M27 and M30 metric diameter threaded steel rods and No. 3 through No. 10 fractional size, $\emptyset 10$, $\emptyset 12$, $\emptyset 14$, $\emptyset 16$, $\emptyset 20$, $\emptyset 25$, $\emptyset 28$ and $\emptyset 32$ EU metric size, and 10M, 15M, 20M, 25M, and 30M Canadian metric size steel reinforcing bars in hammer-drilled (or Aerosmith Fastening Systems hollow drill bit system) holes. Use is limited to normal-weight and lightweight concrete with a specified compressive strength, f'_c , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa).

Aerosmith Sure-Set® Pure Epoxy Plus+ anchor system is used as anchorage to resist static, wind or earthquake (IBC Seismic Design Categories A through F) tension and shear loads in cracked and uncracked normal-weight and lightweight concrete with $\frac{3}{8}$ -, $\frac{1}{2}$ -, $\frac{5}{8}$ -, $\frac{3}{4}$ -, $\frac{7}{8}$ -, 1-, and $1\frac{1}{4}$ -inch fractional diameter threaded steel rods in diamond core-drilled holes. Use is limited to normal-weight and lightweight concrete with a specified compressive strength, f'_c , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa).

Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive anchor system is used as anchorage to resist static, wind or earthquake (IBC Seismic Design Categories A and B only) tension and shear loads in uncracked normal-weight and lightweight concrete with No. 3 through No. 10 fractional size steel reinforcing bars in diamond core-drilled holes. Use is limited to normal-weight and lightweight concrete with a specified compressive strength, f'_c , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa).

Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive anchor system is used as reinforcing bar connections (for development lengths and non-contact splice lengths) to resist static, wind and earthquake (IBC Seismic Design Categories A through F) tension loads in concrete with No. 3 through No. 11 fractional size and $\emptyset 10$, $\emptyset 12$, $\emptyset 14$, $\emptyset 16$, $\emptyset 20$, $\emptyset 25$, $\emptyset 28$, $\emptyset 32$ and $\emptyset 36$ EU metric size, and 10M, 15M, 20M, 25M, and 30M Canadian metric size steel reinforcing bars in hammer-drilled (or Aerosmith Fastening Systems hollow drill bit system) and diamond core drilled holes. Use is limited to normal-weight concrete with a specified compressive strength, f'_c , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa).

The anchor systems comply with anchors as described in Section 1901.3 of the 2024 IBC. The anchor systems may also be used where an engineered design is submitted in accordance with Section R301.1.3 of the IRC.

The post-installed reinforcing bar connection system is an alternative to cast-in-place reinforcing bars governed by ACI 318 and IBC Chapter 19.

3.0 DESCRIPTION

3.1 General:

Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive anchor system is comprised of Aerosmith Sure-Set® Pure Epoxy Plus+ two-component adhesive filled in cartridges, static mixing nozzles and manual or powered dispensing tools, hole cleaning equipment and adhesive injection accessories, and steel anchor elements, which are continuously threaded steel rods or steel reinforcing bars (to form the Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor System).

The primary components of the Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor System, including the Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive cartridge, static mixing nozzle, dispenser, and steel anchor elements, are shown in [Figures 2](#) and [3](#) of this report. The manufacturer's printed installation instructions (MPII), included with each adhesive unit package, are shown in [Figure 5](#) of this report.

3.2 Materials:

3.2.1 Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive: Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive is an injectable two-component epoxy adhesive. The two components are kept separate by means of a labeled dual-cylinder cartridge. The two components combine and react when dispensed through a static mixing nozzle, supplied by Aerosmith Fastening Systems, which is attached to the cartridge. Aerosmith Sure-Set® Pure Epoxy Plus+ is available in 9.5-ounce (280ml) and 20.5-ounce (610ml) cartridges. Each cartridge label is marked with the adhesive expiration date. The shelf life, as indicated by the expiration date, applies to an unopened cartridge stored in a dry, dark, and cool environment, in accordance with the MPII, as illustrated in [Figure 5](#) of this report.

3.2.2 Hole Cleaning Equipment:

3.2.2.1 Standard Equipment: Hole cleaning equipment is comprised of steel wire brushes supplied by Aerosmith Fastening Systems, and air blowers which are shown in [Figure 5](#) of this report. The Aerosmith Fastening Systems dust extraction system shown in [Figure 1](#) of this report removes dust with a HEPA dust extractor during the hole drilling and cleaning operation.

3.2.2.2 Aerosmith Fastening Systems Hollow Drill Bit System: The Aerosmith Fastening Systems hollow drill bit system shown in [Figure 1](#) is comprised of Heller Duster Expert Hollow drill bit with carbide tips conforming to ANSI B212.15 attached to a class M vacuum that has a minimum air flow rating of 90 cfm (150 m³/h, 42 l/s). The vacuum dust extractor system removes the drilling dust during the drilling operation, eliminating the need for additional hole cleaning.

3.2.3 Dispensers: Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive must be dispensed with manual dispensers, pneumatic dispensers, or electric powered dispensers supplied by Aerosmith Fastening Systems.

3.2.4 Steel Anchor Elements:

3.2.4.1 Threaded Steel Rods: Threaded steel rods must be clean and continuously threaded (all-thread) in diameters described in [Tables 4](#) and [12](#) and [Figure 5](#) of this report. Specifications for grades of threaded rod, including the mechanical properties, and corresponding nuts and washers, are included in [Table 2](#) of this report. Carbon steel threaded rods may be furnished with a minimum 0.0002-inch-thick (0.005 mm) zinc electroplated coating complying with ASTM B633 SC 1 or a minimum 0.0021-inch-thick (0.053 mm) mechanically deposited zinc coating complying with ASTM B695, Class 55. The stainless steel threaded rods must comply with [Table 2](#) of this report. Steel grades and types of material (carbon, stainless) for the washers and nuts must match the threaded rods. Threaded steel rods must be clean, straight and free of indentations or other defects along their length. The embedded end may be flat cut or cut on the bias to a chisel point.

3.2.4.2 Steel Reinforcing Bars: Steel reinforcing bars are deformed reinforcing bars as described in [Table 3](#) of this report. [Tables 8](#) and [15](#), and [Figure 5](#) summarize reinforcing bar size ranges. The embedded portions of reinforcing bars must be clean, straight, and free of mill scale, rust, mud, oil and other coatings (other than zinc) that may impair the bond with the adhesive. Reinforcing bars must not be bent after installation except as set forth in ACI 318-19 Section 26.6.3.2 (b) with the additional condition that the bars must be bent cold, and heating of reinforcing bars to facilitate field bending is not permitted.

3.2.4.3 Ductility: In accordance with ACI 318-19 2.3 in order for a steel anchor element to be considered ductile, the tested elongation must be at least 14 percent and reduction of area must be at least 30 percent. Steel elements with a tested elongation less than 14 percent or a reduction of area less than 30 percent, or both, are considered brittle. Values for various steel materials are provided in [Table 2](#) of this report. Where values are nonconforming or unstated, the steel must be considered brittle.

3.2.4.4 Steel Reinforcing Bars for use in Post-Installed Reinforcing Bar Connections: Steel reinforcing bars used in post-installed reinforcing bar connections are deformed reinforcing bars (rebar), with size ranges summarized in [Tables 19](#), [20](#), and [21](#). The embedded portions of reinforcing bars must be straight, and free of mill scale, rust and other coatings that may impair the bond with the adhesive. Reinforcing bars must not be bent after installation except as set forth in ACI 318-19 Section 26.6.3.2 (b) with the additional condition that the bars must be bent cold, and heating of reinforcing bars to facilitate field bending is not permitted.

3.3 Concrete:

Normal-weight and lightweight concrete must comply with Sections 1903 and 1905 of the IBC. The specified compressive strength of the concrete must be from 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa).

4.0 DESIGN AND INSTALLATION

4.1 Strength Design:

4.1.1 General: The design strength of anchors under the 2024 IBC must be determined in accordance with ACI 318-19 and this report.

The strength design of anchors must comply with ACI 318-19 17.5.1.2 except as required in ACI 318-19 17.10.

Design parameters are provided in [Tables 4](#) through [18](#) of this report. Strength reduction factors, ϕ , as given in ACI 318-19 17.5.3 must be used for load combinations calculated in accordance with Section 1605.1 of the 2024 IBC or ACI 318-19 5.3.

4.1.2 Static Steel Strength in Tension: The nominal static steel strength of a single anchor in tension, N_{sa} , in accordance with ACI 318-19 17.6.1.2 and the associated strength reduction factors, ϕ , in accordance with ACI 318-19 17.5.3 are provided in [Tables 4](#), [8](#), [12](#) and [15](#) of this report for the corresponding anchor steel.

4.1.3 Static Concrete Breakout Strength in Tension: The nominal static concrete breakout strength of a single anchor or group of anchors in tension, N_{cb} or N_{cbg} , must be calculated in accordance with ACI 318-19 17.6.2 with the following addition:

The basic concrete breakout strength of a single anchor in tension, N_b , must be calculated in accordance with ACI 318-19 17.6.2.2 using the values of $k_{c,cr}$ and $k_{c,uncr}$ as provided in [Tables 5](#), [9](#), [13](#), and [16](#) of this report. Where analysis indicates no cracking in accordance with ACI 318-19 17.6.2.5 N_b must be calculated using $k_{c,uncr}$ and $\psi_{c,N} = 1.0$. For anchors in lightweight concrete see ACI 318-19 17.2.4. The value of f'_c used for calculation must be limited to 8,000 psi (55 MPa) in accordance with ACI 318-19 17.3.1. Additional information for the determination of nominal bond strength in tension is given in Section 4.1.4 of this report.

4.1.4 Static Bond Strength in Tension: The nominal static bond strength of a single adhesive anchor or group of adhesive anchors in tension, N_a or N_{ag} , must be calculated in accordance with ACI 318-19 17.6.5.

Bond strength values ($\tau_{k,cr}$, $\tau_{k,uncr}$) are a function of concrete compressive strength, concrete state (cracked, uncracked), drilling method (hammer-drilled, core-drilled) and installation conditions (dry concrete, water-saturated concrete, water-filled holes, submerged concrete). The following table summarizes the requirements:

DRILLING METHOD	CONCRETE STATE	BOND STRENGTH	CONCRETE COMPRESSIVE STRENGTH	PERMISSIBLE INSTALLATION CONDITIONS	ASSOCIATED STRENGTH REDUCTION FACTOR
Hammer-drilled	Cracked and Uncracked	$\tau_{k,cr}$ OR $\tau_{k,uncl}$	f'_c	Dry concrete	ϕ_d
				Water-saturated concrete	ϕ_{ws}
				Water-filled hole (flooded)	$K_{wf} \cdot \phi_{wf}$
				Underwater (submerged)	ϕ_{uw}
Core-drilled	Cracked and Uncracked	$\tau_{k,cr}$ OR $\tau_{k,uncl}$	f'_c	Dry concrete	ϕ_d
				Water-saturated concrete	ϕ_{ws}

Strength reduction factors for determination of the bond strength are given in [Tables 6, 7, 10, 11, 14, 17, and 18](#) of this report. Adjustments to the bond strength may also be made for increased concrete compressive strength as noted in the footnotes to the corresponding tables and this section.

The bond strength values in [Tables 6, 7, 10, 11, 14, 17, and 18](#) of this report correspond to concrete compressive strength f'_c equal to 2,500 psi (17.2 MPa).

For concrete compressive strength, f'_c between 2,500 psi and 8,000 psi (17.2 MPa and 55 MPa), the tabulated characteristic bond strength in hammer-drilled (or Aerosmith Fastening Systems hollow drill bit system) holes may be increased as follows: threaded rod in uncracked concrete by $(f'_c / 2,500)^{0.21}$ [For SI: $f'_c / 17.2)^{0.21}$]; threaded rod in cracked concrete by $(f'_c / 2,500)^{0.14}$ [For SI: $f'_c / 17.2)^{0.14}$]; fractional and EU metric reinforcing bar in uncracked concrete by $(f'_c / 2,500)^{0.18}$ [For SI: $f'_c / 17.2)^{0.18}$]; Canadian metric reinforcing bar in uncracked concrete by $(f'_c / 2,500)^{0.09}$ [For SI: $f'_c / 17.2)^{0.09}$]; Canadian metric reinforcing bar in cracked concrete by $(f'_c / 2,500)^{0.08}$ [For SI: $f'_c / 17.2)^{0.08}$].

For concrete compressive strength, f'_c between 2,500 psi and 8,000 psi (17.2 MPa and 55 MPa), the tabulated characteristic bond strength in diamond core drilled holes may be increased as follows: threaded rod in uncracked concrete by $(f'_c / 2,500)^{0.24}$ [For SI: $f'_c / 17.2)^{0.24}$]; threaded rod in cracked concrete by $(f'_c / 2,500)^{0.20}$ [For SI: $f'_c / 17.2)^{0.20}$]; and fractional and EU metric reinforcing bar in uncracked concrete by $(f'_c / 2,500)^{0.35}$ [For SI: $f'_c / 17.2)^{0.35}$].

Where applicable, the modified bond strength values must be used in lieu of $\tau_{k,cr}$ and $\tau_{k,uncl}$ in ACI 318-19 (17.6.5.1.2b) and (17.6.5.2.1).

The resulting nominal bond strength must be multiplied by the associated strength reduction factor ϕ_d , ϕ_{ws} , ϕ_{wf} or ϕ_{uw} , as applicable.

4.1.5 Static Steel Strength in Shear: The nominal static steel strength of a single anchor in shear as governed by the steel, V_{sa} , in accordance with ACI 318-19 17.7.1.2 and the strength reduction factor, ϕ , in accordance with ACI 318-19 17.5.3 are given in [Tables 4, 8, 12 and 15](#) of this report for the corresponding anchor steel.

4.1.6 Static Concrete Breakout Strength in Shear: The nominal static concrete breakout strength of a single anchor or group of anchors in shear, V_{cb} or V_{cbg} , must be calculated in accordance with ACI 318-19 17.7.2 based on information given in [Tables 5, 9, 13, and 16](#) in this report.

The basic concrete breakout strength of a single anchor in shear, V_b , must be calculated in accordance with ACI 318-19 17.7.2.2 using the values of d given in [Tables 5, 9, 13, and 16](#) for the corresponding anchor steel in lieu of d_a . In addition, h_{ef} must be substituted for ℓ_e . In no case shall ℓ_e exceed $8d$. The value of f'_c shall be limited to a maximum of 8,000 psi (55 MPa) in accordance with ACI 318-19 17.3.1.

4.1.7 Static Concrete Pryout Strength in Shear: The nominal static pryout strength of a single anchor or group of anchors in shear, V_{cp} or V_{cpg} , shall be calculated in accordance with ACI 318-19 17.7.3.

4.1.8 Interaction of Tensile and Shear Forces: For designs that include combined tension and shear, the interaction of tension and shear loads must be calculated in accordance with ACI 318-19 17.8.

4.1.9 Minimum Member Thickness h_{min} , Anchor Spacing s_{min} , Edge Distance c_{min} : In lieu of ACI 318-19 17.9.2 values of s_{min} and c_{min} described in this report must be observed for anchor design and installation. The

minimum member thicknesses, h_{min} , described in this report must be observed for anchor design and installation. For adhesive anchors that will remain untorqued, ACI 318-19 17.9.3.

For anchors that will be torqued during installation, the maximum torque, T_{max} , must be reduced for edge distances less than five anchor diameters ($5d$). T_{max} is subject to the edge distance, c_{min} , and anchor spacing, s_{min} , and shall comply with the following requirements:

INSTALLATION TORQUE SUBJECT TO EDGE DISTANCE			
NOMINAL ANCHOR SIZE, D	MINIMUM EDGE DISTANCE, c_{min}	MINIMUM ANCHOR SPACING, s_{min}	MAXIMUM TORQUE, T_{max}
$\frac{5}{8}$ in. to 1 in. #5 to #8 M16 to M27 $\varnothing 14$ to $\varnothing 25$ 15M to 25M	1.75 in. (45 mm)	$5d$	$0.45 \cdot T_{max}$
$1\frac{1}{4}$ in. #9 to #10 M30 $\varnothing 28$ to $\varnothing 32$ 30M	2.75 in. (70 mm)		

For values of T_{max} , see [Figure 5](#) of this report.

4.1.10 Critical Edge Distance c_{ac} and $\psi_{cp,Na}$: The modification factor, $\psi_{cp,Na}$, must be determined in accordance with ACI 318-19 17.6.5.5 except as noted below:

For all cases where $c_{Na}/c_{ac} < 1.0$, $\psi_{cp,Na}$ determined from ACI 318-19 Eq. 17.6.5.5.1b need not be taken less than c_{Na}/c_{ac} . For all other cases, $\psi_{cp,Na}$ shall be taken as 1.0.

The critical edge distance, c_{ac} must be calculated according to Eq. 17.6.5.5.1c of ACI 318-19 in lieu of ACI 318-19 17.9.5.

$$c_{ac} = h_{ef} \cdot \left(\frac{\tau_{k,uncr}}{1160} \right)^{0.4} \cdot \left[3.1 - 0.7 \frac{h}{h_{ef}} \right]$$

(Eq. 17.6.5.5.1c for ACI 318-19)

where

$\left[\frac{h}{h_{ef}} \right]$ need not be taken as larger than 2.4; and

$\tau_{k,uncr}$ = the characteristic bond strength stated in the tables of this report whereby $\tau_{k,uncr}$ need not be taken as larger than:

$$\tau_{k,uncr} = \frac{k_{uncr} \sqrt{h_{ef} f'_c}}{\pi \cdot d_a} \quad \text{Eq. (4-1)}$$

4.1.11 Requirements for Seismic Design Categories C, D, E and F: In structures assigned to Seismic Design Category C, D, E or F under the IBC or IRC, anchors must be designed in accordance with ACI 318-19 17.10.

The nominal steel shear strength, V_{sa} , must be adjusted by $\alpha_{V,seis}$ as given in [Tables 4, 8, 12](#), and [15](#) for the corresponding anchor steel. The nominal bond strength $\tau_{k,cr}$ must be adjusted by $\alpha_{N,seis}$ as given in [Tables 6, 7, 10, 14, 17](#), and [18](#) for the corresponding anchor steel.

4.2 Strength Design of Post-Installed Reinforcing Bars:

4.2.1 General: The design of straight post-installed deformed reinforcing bars must be determined in accordance with ACI 318 rules for cast-in-place reinforcing bar development and splices and this report.

4.2.2 Determination of bar development length l_d : Values of l_d must be determined in accordance with the ACI 318 development and splice length requirements for straight cast-in-place reinforcing bars.

Exceptions:

1. For uncoated and zinc-coated (galvanized) post-installed reinforcing bars, the factor ψ_e shall be taken as 1.0. For all other cases, the requirements in ACI 318-19 Table 25.4.2.5 shall apply.

2. When using alternate methods to calculate the development length (e.g. anchor theory), the applicable factors for post-installed anchors generally apply.

4.2.3 Minimum Member Thickness, h_{min} , Minimum Concrete Cover, $c_{c,min}$, Minimum Concrete Edge Distance, $c_{b,min}$, Minimum Spacing, $s_{b,min}$: For post-installed reinforcing bars, there is no limit on the minimum member thickness. In general, all requirements on concrete cover and spacing applicable to straight cast-in-bars designed in accordance with ACI 318 shall be maintained.

For post-installed reinforcing bars installed at embedment depths greater than $20d$ ($h_{ef} > 20d$), the minimum concrete cover shall be as follows:

REBAR SIZE	MINIMUM CONCRETE COVER, $c_{c,min}$
$d_b \leq \text{No. 6}$ ($d_b \leq 16 \text{ mm}$; $d_b \leq 15\text{M}$)	$1\text{-}\frac{3}{16} \text{ in.}$ (30 mm)
$\text{No. 6} < d_b \leq \text{No. 11}$ ($16 \text{ mm} < d_b \leq 36 \text{ mm}$; $15\text{M} < d_b \leq 35\text{M}$)	$1\text{-}\frac{9}{16} \text{ in.}$ (40 mm)

The following requirements apply for minimum concrete edge and spacing for $h_{ef} > 20d$:

Required minimum edge distance for post-installed reinforcing bars (measured from the center of the bar):

$$c_{b,min} = d_o/2 + c_{c,min}$$

Required minimum center-to-center spacing between post-installed bars:

$$s_{b,min} = d_o + c_{c,min}$$

Required minimum center-to-center spacing from existing (parallel reinforcing):

$$s_{b,min} = d_b/2 \text{ (existing reinforcing)} + d_o/2 + c_{c,min}$$

All other requirements applicable to straight cast-in place bars designed in accordance with ACI 318 shall be maintained.

4.2.4 Design Strength in Seismic Design Categories C, D, E and F: In structures assigned to Seismic Category C, D, E or F under the IBC or IRC, design of straight post-installed reinforcing bars must consider the provisions of ACI 318-19 Chapter 18.

4.2.5 Design in Fire Resistive Construction Conditions: For post-installed reinforcing bars, the relationship of bond stress to temperature under fire conditions suitable for use in determining conformance with fire resistance rating requirements is as given in [Figure 4](#).

For temperatures above θ_{max} of 477°F (247°C), $\tau_{fire}(\theta) = 0$. The bond stress $\tau_{fire}(\theta)$, shall not exceed 1,090 psi (7.5 N/mm^2).

Where θ is the temperature in the concrete at the post-installed reinforcing bar in $^\circ\text{F}$ (for psi) or $^\circ\text{C}$ (for N/mm^2), as applicable.

Determination of the temperature in the concrete at the location of the post-installed reinforcing bar is dependent on the geometry of the concrete members under consideration and its calculation is the responsibility of the design professional. The design professional shall use the bond strength / temperature curves in [Figure 4](#) along with a determination of the temperature in the concrete appropriate for the member geometry under consideration to calculate the reinforcing bar development length l_d .

4.3 Allowable Stress Design (ASD):

4.3.1 General: For anchors designed using load combinations in accordance with Section 1605.1 of the 2024 IBC (Allowable Stress Design), allowable loads shall be established using Eq. (4-2) or Eq. (4-3):

$$T_{allowable,ASD} = \phi N_n / \alpha \quad \text{Eq. (4-2)}$$

and

$$V_{allowable,ASD} = \phi V_n / \alpha \quad \text{Eq. (4-3)}$$

where:

$$T_{allowable,ASD} = \text{Allowable tension load (lbf or kN)}$$

$V_{allowable, ASD}$ = Allowable shear load (lbf or kN)

ϕN_n = The lowest design strength of an anchor or anchor group in tension as determined in accordance with ACI 318-19 Chapter 17, 2024 IBC Section 1905.7, and Section 4.1 of this report, as applicable.

ϕV_n = The lowest design strength of an anchor or anchor group in shear as determined in accordance with ACI 318-19 Chapter 17, 2024 IBC Section 1905.7, and Section 4.1 of this report, as applicable.

α = Conversion factor calculated as a weighted average of the load factors for the controlling load combination. In addition, α must include all applicable factors to account for non-ductile failure modes and required over-strength.

The requirements for member thickness, edge distance and spacing, described in [Table 1](#) of this report, must apply.

4.3.2 Interaction of Tensile and Shear Forces: In lieu of ACI 318-19 17.8.2 and 17.8.3, interaction of tension and shear loads must be calculated as follows:

If $T_{applied} \leq 0.2 T_{allowable, ASD}$, then the full allowable strength in shear, $V_{allowable, ASD}$, shall be permitted.

If $V_{applied} \leq 0.2 V_{allowable, ASD}$, then the full allowable strength in tension, $T_{allowable, ASD}$, must be permitted.

For all other cases:

$$\frac{T_{applied}}{T_{allowable, ASD}} + \frac{V_{applied}}{V_{allowable, ASD}} \leq 1.2 \quad \text{Eq. (4-4)}$$

4.4 Installation:

Installation parameters are illustrated in [Figures 2](#) and [5](#) and [Tables 5, 9, 13](#), and [16](#) of this report. Installation must be in accordance with ACI 318-19 26.7.2. Anchor locations must comply with this report and the plans and specifications approved by the code official. Installation of the Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor System must conform to the manufacturer's printed installation instructions included in each unit package as described in [Figure 5](#) of this report.

The adhesive anchor system may be installed in downwards, horizontally and upwardly inclined orientation applications (e.g. overhead). If the bottom or back of the drilled hole is not reached with the mixing nozzle, a mixer extension tube, supplied by Aerosmith Fastening Systems must be attached to the mixing nozzle as described in [Figure 5](#) of this report. Additionally, for upwardly inclined or between horizontal and upwardly inclined orientation applications of all drilled hole depths, and downward and horizontal applications with a drilled hole depth of more than 10 inch (250 mm) are to be installed using piston plugs for the 5/8-inch, and M16 through 1 1/4-inch and M30 diameter threaded steel rods, and No. 5, ø14, and 15M through No. 10, ø32, and 30M, steel reinforcing bars, installed in the specified hole diameter, and attached to the mixing nozzle and extension tube supplied by Aerosmith Fastening Systems as described in [Figure 5](#) in this report. For installation with the 3/8-inch, 1/2-inch, M10 and M12 diameter threaded steel rods, and No. 3, No. 4, ø10, ø12, and 10M steel reinforcing bars only, a piston plug is not required.

Installation of anchors in horizontal or upwardly inclined orientations shall be fully restrained from movement throughout the specified curing period through the use of temporary wedges, external supports, or other methods. Where temporary restraint devices are used, their use shall not result in impairment of the anchor shear resistance.

4.5 Special Inspection:

Periodic special inspection must be performed where required in accordance with Section 1705.1.1 and Table 1705.3 of the 2024 IBC and this report. The special inspector must be on the jobsite initially during anchor installation to verify the anchor type, adhesive expiration date, anchor dimensions, concrete type, concrete compressive strength, hole dimensions, hole cleaning procedures, anchor spacing, edge distances, concrete thickness, anchor embedment, tightening torque, and adherence to the manufacturer's printed installation instructions.

The special inspector must verify the initial installations of each type and size of adhesive anchor by construction personnel on site. Subsequent installations of the same anchor type and size by the same construction personnel are permitted to be performed in the absence of the special inspector. Any change in the anchor product being installed or the personnel performing the installation requires an initial inspection.

For ongoing installations over an extended period, the special inspector must make regular inspections to confirm correct handling and installation of the product.

Continuous special inspection of adhesive anchors installed in horizontal or upwardly inclined orientations to resist sustained tension loads must be performed in accordance with ACI 318-19 26.13.3.2(e).

Under the IBC, additional requirements as set forth in Sections 1705, 1706 or 1707 must be observed, where applicable.

5.0 CONDITIONS OF USE:

- 5.1 Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive anchors and post-installed reinforcing bars must be installed in accordance with the manufacturer's printed installation instructions included with each cartridge and provided in [Figure 5](#) of this report.
- 5.2 Anchors [$\frac{3}{8}$ -, $\frac{1}{2}$ -, $\frac{5}{8}$ -, $\frac{3}{4}$ -, $\frac{7}{8}$ -, 1-, and $1\frac{1}{4}$ -inch fractional diameter and M10, M12, M16, M20, M24, M27 and M30 metric diameter threaded steel rods, and No. 3 through No. 10 fractional size, $\emptyset 10$, $\emptyset 12$, $\emptyset 14$, $\emptyset 16$, $\emptyset 20$, $\emptyset 25$, $\emptyset 28$ and $\emptyset 32$ EU metric, and 10M, 15M, 20M, 25M, and 30M Canadian steel reinforcing bars] described in this report must be installed in cracked and uncracked normal-weight concrete having a specified compressive strength $f_c = 2,500$ psi to 8,500 psi (17.2 MPa to 58.6 MPa).
- 5.3 Post-installed reinforcing bars with diameters No. 3 through No. 11 fractional size and $\emptyset 10$, $\emptyset 12$, $\emptyset 14$, $\emptyset 16$, $\emptyset 20$, $\emptyset 25$, $\emptyset 28$, $\emptyset 32$ and $\emptyset 36$ EU metric, and 10M, 15M, 20M, 25M, and 30M Canadian size steel reinforcing bars in hammer-drilled (or Aerosmith Fastening Systems hollow drill bit system) and diamond cored holes are used in cracked and uncracked normal-weight concrete only, to resist static, wind or earthquake (IBC Seismic Design Categories A through F) tension and shear loads. Use is limited to normal-weight concrete with a specified compressive strength, $f_c = 2,500$ psi to 8,500 psi (17.2 MPa to 58.6 MPa).
- 5.4 The values of f_c used for calculation purposes must not exceed 8,000 psi (55 MPa).
- 5.5 Anchors and post-installed reinforcing bars must be installed in concrete base materials in holes predrilled in accordance with the instructions provided in [Figure 5](#) of this report.
- 5.6 Loads applied to the anchors must be adjusted in accordance with Section 1605.1 of the 2024 IBC for strength design or for allowable stress design.
- 5.7 In structures assigned to Seismic Design Categories C, D, E, and F under the IBC or IRC, anchor strength must be adjusted in accordance with Section 4.1.11 of this report.
- 5.8 Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive anchors are permitted to be installed in concrete that is cracked or that may be expected to crack during the service life of the anchor, subject to the conditions of this report.
- 5.9 Strength design values are established in accordance with Section 4.1 of this report.
- 5.10 Minimum anchor spacing and edge distance as well as minimum member thickness must comply with the values described in this report.
- 5.11 Prior to anchor installation, calculations and details demonstrating compliance with this report must be submitted to the code official. The calculations and details must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.12 Anchors are not permitted to support fire-resistive construction. Where not otherwise prohibited by the code, Aerosmith Sure-Set® Pure Epoxy Plus+ adhesive anchors are permitted for installation in fire-resistive construction provided that at least one of the following conditions is fulfilled:
 - Anchors are used to resist wind or seismic forces only.
 - Anchors that support gravity load-bearing structural elements are within a fire-resistive envelope or a fire-resistive membrane, are protected by approved fire-resistive materials, or have been evaluated for resistance to fire exposure in accordance with recognized standards.
 - Anchors are used to support nonstructural elements.
 - Post-installed reinforcing bars designed in accordance with Section 4.2.5 of this report.
- 5.13 Since an ICC-ES acceptance criteria for evaluating data to determine the performance of adhesive anchors subjected to fatigue or shock loading is unavailable at this time, the use of these anchors under such conditions is beyond the scope of this report.
- 5.14 Use of zinc-plated carbon steel threaded rods or steel reinforcing bars is limited to dry, interior locations.

- 5.15** Use of hot-dipped galvanized carbon steel and stainless steel rods is permitted for exterior exposure or damp environments.
- 5.16** Steel anchoring materials in contact with preservative-treated and fire-retardant-treated wood shall be of zinc-coated steel or stainless steel. The minimum coating weights for zinc-coated steel shall be in accordance with ASTM A153.
- 5.17** Periodic special inspection must be provided in accordance with Section 4.5 in this report. Continuous special inspection for anchors installed in horizontal or upwardly inclined orientations to resist sustained tension loads must be provided in accordance with Section 4.5 of this report.
- 5.18** Installation of anchors and post-installed reinforcing bars in horizontal or upwardly inclined orientations to resist sustained tension loads must be performed by personnel certified by an applicable certification program in accordance with ACI 318-19 26.7.1(l) and 26.7.2(e).
- 5.19** Aerosmith Sure-Set[®] Pure Epoxy Plus+ adhesive anchors and post-installed reinforcing bars may be used to resist tension and shear forces in floor, wall for overhead installations into concrete with a temperature between 41°F and 104°F (5°C and 40°C) for threaded rods and reinforcing bars.
- 5.20** Aerosmith Sure-Set[®] Pure Epoxy Plus+ adhesive is manufactured in Willich, Germany, and Lonoke, Arkansas under a quality control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED

Data in accordance with the [ICC-ES Acceptance Criteria for Post-installed Adhesive Anchors and Reinforcing Bar Connections in Concrete AC308 \(24\)](#), published April 2025, which incorporates requirements in ACI 355.4-11 and ACI 355.4-19 for use in cracked and uncracked concrete.

7.0 IDENTIFICATION

- 7.1** The ICC-ES mark of conformity, electronic labeling, or the evaluation report number (ICC-ES ESR-5901) along with the name, registered trademark, or registered logo of the report holder must be included in the product label.
- 7.2** Additionally, Aerosmith Sure-Set[®] Pure Epoxy Plus+ adhesive is identified by packaging labeled with the manufacturer's name (Aerosmith Fastening Systems) and address, anchor name, the lot number and the expiration date. Threaded rods, nuts, washers, and deformed reinforcing bars are standard steel anchor elements and must conform to applicable national or international specifications as set forth in [Tables 2](#) and [3](#) of this report.
- 7.3** The report holder's contact information is the following:

AEROSMITH FASTENING SYSTEMS
5621 DIVIDEND ROAD
INDIANAPOLIS, INDIANA 46241
UNITED STATES
(800) 528-8183
<https://www.Aerosmithfastening.com>

TABLE 1—DESIGN TABLE INDEX

DESIGN STRENGTH ¹ - THREADED RODS		Fractional	Metric	
	Steel Strength - N_{sa} , V_{sa}	Table 4	Table 12	
	Concrete Strength - N_{pr} , N_{sb} , N_{sbg} , N_{cb} , N_{cbg} , V_{cb} , V_{cbg} , V_{cp} , V_{cpg}	Table 5	Table 13	
	Bond Strength ² - N_b , N_{bg}	Table 6 and Table 7	Table 14	
DESIGN STRENGTH ¹ - REINFORCING STEEL		Fractional	EU Metric	Canadian
	Steel Strength - N_{sa} , V_{sa}	Table 8	Table 15	Table 15
	Concrete Strength - N_{pr} , N_{sb} , N_{sbg} , N_{cb} , N_{cbg} , V_{cb} , V_{cbg} , V_{cp} , V_{cpg}	Table 9	Table 16	Table 16
	Bond Strength ² - N_b , N_{bg}	Table 10 and Table 11	Table 17	Table 18
	Determination of development lengths and non-contact lap splices for post-installed reinforcing bar connections	Table 19	Table 20	Table 21

¹Ref. ACI 318-19 17.5.2.²See Section 4.1 of this evaluation report.TABLE 2—SPECIFICATIONS AND PHYSICAL PROPERTIES OF COMMON CARBON AND STAINLESS STEEL THREADED ROD MATERIALS¹

THREADED ROD SPECIFICATION			MINIMUM SPECIFIED ULTIMATE STRENGTH, f_{uta}	MINIMUM SPECIFIED YIELD STRENGTH 0.2 PERCENT OFFSET, f_{ya}	f_{uta}/f_{ya}	ELONGATION, MIN. PERCENT ¹¹	REDUCTION OF AREA, MIN. PERCENT	SPECIFICATION FOR NUTS ¹²
CARBON STEEL	ASTM A193 ² Grade B7 all sizes	psi (MPa)	125,000 (862)	105,000 (724)	1.19	16	50	ASTM A194 / A563 Grade DH
	ASTM A36 ³ / F1554 ⁴ , Grade 36 all sizes	psi (MPa)	58,000 (400)	36,000 (250)	1.61	23	40	ASTM A194 / A563 Grade A
	ASTM F1554 ⁴ Grade 55	psi (MPa)	75,000 (517)	55,000 (380)	1.36	23	40	
	ASTM F1554 ⁴ Grade 105	psi (MPa)	125,000 (860)	105,000 (724)	1.19	15	45	ASTM A194 / A563 Grade DH
	ASTM A449 ⁵ ³ / ₈ to 1 in.	psi (MPa)	120,000 (830)	92,000 (635)	1.30	14	35	
	ASTM A449 ⁵ 1 ¹ / ₄ in	psi (MPa)	105,000 (720)	81,000 (560)	1.30	14	35	
	ASTM F568M ⁶ Class 5.8 (equivalent to ISO 898-1)	psi (MPa)	72,500 (500)	58,000 (400)	1.25	10	35	ASTM A563 Grade DH DIN 934 (8-A2K) ¹³
	ISO 898-1 ⁷ Class 5.8	MPa (psi)	500 (72,500)	400 (58,000)	1.25	22	-	EN ISO 4032 Grade 6
	ISO 898-1 ⁷ Class 8.8	MPa (psi)	800 (116,000)	640 (92,800)	1.25	12	52	EN ISO 4032 Grade 8
STAINLESS STEEL	ASTM F593 ⁸ CW1 ³ / ₈ to ⁵ / ₈ in. (316)	psi (MPa)	100,000 (690)	65,000 (450)	1.54	20	-	ASTM F594 Alloy Group 1, 2 or 3
	ASTM F593 ⁸ CW2 ³ / ₄ to 1 ¹ / ₄ in. (316)	psi (MPa)	85,000 (590)	45,000 (310)	1.89	25	-	
	ASTM A193/A193M ⁹ Grade B8/B8M2, Class 2B	psi (MPa)	95,000 (655)	75,000 (515)	1.27	25	40	ASTM A194/A194M
	ISO 3506-1 ¹⁰ A4-70 (M8-M24)	MPa (psi)	700 (101,500)	450 (65,250)	1.56	40	-	EN ISO 4032
	ISO 3506-1 ¹⁰ A4-50 (M27-M30)	MPa (psi)	500 (72,500)	210 (30,450)	2.38	40	-	EN ISO 4032

¹Adhesive must be used with continuously threaded carbon or stainless steel rod (all-thread) having thread characteristics complying with ANSI B1.1 UNC Coarse Thread Series.²Standard Specification for Alloy-Steel and Stainless steel Bolting Materials for High temperature of High Pressure service and Other Special Purpose Applications.³Standard Specification for Carbon Structural steel⁴Standard Specification for Anchor Bolts, Steel 36, 55 and 105-ksi Yield Strength.⁵Standard Specification for Hex Cap Screws, Bolts and Studs, Heat Treated, 120/105/50 ksi Minimum Tensile Strength, General Use.⁶Standard Specification for Carbon and Alloy Steel external Threaded Metric Fasteners.⁷Mechanical properties of fasteners made of carbon steel and alloy steel - Part 1: Bolts, Screws and Studs.⁸Standard Specification for Alloy-Steel and Stainless Steel Bolting for High Temperature or High Pressure Service and Other Special Purpose Applications.⁹Standard Specification for Stainless Steel Bolts, Hex Cap Screws, and Studs.¹⁰Mechanical properties of corrosion-resistant stainless steel fasteners - Part 1: Bolts, Screws and Studs.¹¹Based on 2-in. (50 mm) gauge length except for ASTM A193, which is based on a gauge length of 4d.¹²Nuts and washers of other grades and style having specified proof load stress greater than the specified grade and style are also suitable. Nuts must have specified proof load stresses equal to or greater than the minimum tensile strength of the specified threaded rod.¹³Nuts for metric rods.

TABLE 3—SPECIFICATIONS AND PHYSICAL PROPERTIES OF COMMON CARBON REINFORCING BARS

REINFORCING SPECIFICATION	UNITS	MINIMUM SPECIFIED ULTIMATE STRENGTH, f_{uta}	MINIMUM SPECIFIED YIELD STRENGTH, f_{ya}
ASTM A615 ¹ , A767 ³ Grade 75	psi (MPa)	100,000 (690)	75,000 (520)
ASTM A615 ¹ , A767 ³ , A996 ⁴ Grade 60	psi (MPa)	80,000 (620)	60,000 (414)
ASTM A706 ² , A757 ³ Grade 60	psi (MPa)	80,000 (550)	60,000 (414)
ASTM A615 ¹ , Grade 40	psi (MPa)	60,000 (415)	40,000 (275)
DIN 488 ⁵ Bst 500	MPa (psi)	550 (80,000)	500 (72,500)
CAN/CSA-G30.18 ⁶ Gr. 400	MPa (psi)	540 (78,300)	400 (58,000)

¹Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement.
²Standard Specification for Low-Alloy Steel Deformed and Plain Bars for Concrete Reinforcement.
³Standard specification for Zinc-Coated (Galvanized) steel Bars for Concrete Reinforcement.
⁴Standard specification for Rail-Steel and Axle-steel Deformed bars for Concrete Reinforcement.
⁵Reinforcing steel, reinforcing steel bars; dimensions and masses.
⁶Billet-Steel Bars for Concrete Reinforcement

Drilling and cleaning	Tool	Accessories and Shrouds	Vacuum
Dust extraction system for standard drilling and cleaning equipment		 SDS-Plus and SDS-Max Drill Bit  Capture Device CAT# 01128	 Dust Extractor
Aerosmith Fastening Systems hollow drill bit system		 Heller Duster Expert SDS-Plus and SDS-Max Hollow Drill Bit	 Class M vacuum with a minimum air flow rating of 90cfm (150m ³ /h resp. 42l/s).

FIGURE 1— AEROSMITH FASTENING SYSTEMS DUST REMOVAL DRILLING SYSTEM WITH HEPA DUST EXTRACTOR OPTIONS

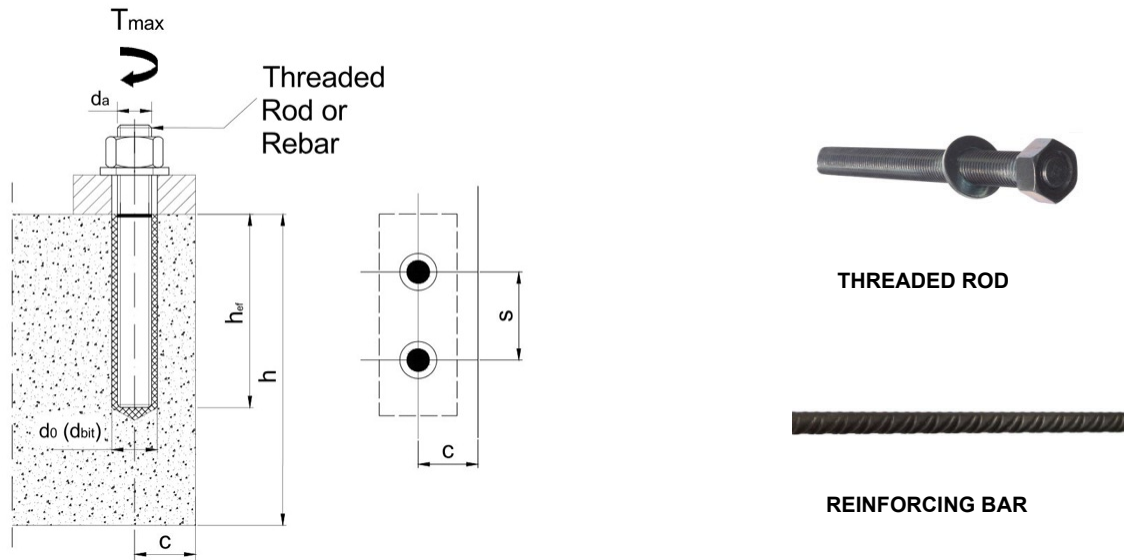


FIGURE 2—INSTALLATION PARAMETERS FOR THREADED RODS AND REINFORCING BARS

TABLE 4—STEEL DESIGN INFORMATION FOR U.S. CUSTOMARY UNIT THREADED ROD¹

DESIGN INFORMATION		Symbol	Units	Nominal Rod Diameter (inch)						
				$\frac{3}{8}$	$\frac{1}{2}$	$\frac{5}{8}$	$\frac{3}{4}$	$\frac{7}{8}$	1	$1\frac{1}{4}$
Threaded rod O.D.		d_a	in. (mm)	0.375 (9.5)	0.500 (12.7)	0.625 (15.9)	0.750 (19.1)	0.875 (22.2)	1.000 (25.4)	1.250 (31.8)
Threaded rod effective cross-sectional area		A_{se}	in. ² (mm ²)	0.0775 (50)	0.1419 (92)	0.2260 (146)	0.3345 (216)	0.4617 (298)	0.6057 (391)	0.9691 (625)
ASTM A36/F1554, Grade 36	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	4,495 (20.0)	8,230 (36.6)	13,110 (58.3)	19,400 (86.3)	26,780 (119.1)	35,130 (156.3)	56,210 (250.0)
		V_{sa}	lb (kN)	2,695 (12.0)	4,940 (22.0)	7,860 (35.0)	11,640 (51.8)	16,070 (71.4)	21,080 (93.8)	33,725 (150.0)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.75						
	Strength reduction factor for shear ²	ϕ	-	0.65						
ASTM F1554 Grade 55	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	5,815 (25.9)	10,645 (47.6)	16,950 (75.5)	25,090 (111.7)	34,630 (154.1)	45,430 (202.1)	72,685 (323.1)
		V_{sa}	lb (kN)	3,490 (15.5)	6,385 (28.6)	10,170 (45.3)	15,055 (67)	20,780 (92.5)	27,260 (121.3)	43,610 (193.9)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.75						
	Strength reduction factor for shear ²	ϕ	-	0.65						
ASTM A193 Grade B7 ASTM F1554 Grade 105	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	9,685 (43.1)	17,735 (78.9)	28,250 (125.7)	41,810 (186.0)	57,710 (256.7)	75,710 (336.8)	121,135 (538.8)
		V_{sa}	lb (kN)	5,810 (25.9)	10,640 (47.3)	16,950 (75.4)	25,085 (111.6)	34,625 (154.0)	45,425 (202.1)	72,680 (323.3)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.75						
	Strength reduction factor for shear ²	ϕ	-	0.65						
ASTM A449	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	9,300 (41.4)	17,030 (76.2)	27,120 (120.9)	40,140 (178.8)	55,405 (246.7)	72,685 (323.7)	101,755 (450.0)
		V_{sa}	lb (kN)	5,580 (24.8)	10,220 (45.7)	16,270 (72.5)	24,085 (107.3)	33,240 (148)	43,610 (194.2)	61,055 (270.0)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.75						
	Strength reduction factor for shear ²	ϕ	-	0.65						
ASTM F688M Class 5.8	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	5,620 (25)	10,290 (46)	16,385 (73)	24,250 (108)	33,470 (149)	43,910 (195.5)	70,260 (312.5)
		V_{sa}	lb (kN)	3,370 (15)	6,175 (27.6)	9,830 (43.8)	14,550 (64.8)	20,085 (89.4)	26,350 (117.3)	42,155 (187.5)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.65						
	Strength reduction factor for shear ²	ϕ	-	0.60						
ASTM F593 CW Stainless	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	7,750 (34.5)	14,190 (63.1)	22,600 (100.5)	28,430 (126.5)	39,245 (174.6)	51,485 (229.0)	82,370 (366.4)
		V_{sa}	lb (kN)	4,650 (20.7)	8,515 (37.9)	13,560 (60.3)	17,060 (75.9)	23,545 (104.7)	30,890 (137.4)	49,425 (219.8)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.65						
	Strength reduction factor for shear ²	ϕ	-	0.60						
ASTM A193/A193M Grade B8/B8M2, Class 2B	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	7,365 (32.8)	13,480 (60.3)	21,470 (95.6)	31,780 (141.5)	43,860 (195.2)	57,540 (256.1)	92,065 (409.4)
		V_{sa}	lb (kN)	4,420 (19.7)	8,090 (36.2)	12,880 (57.4)	19,070 (84.9)	26,320 (117.1)	34,525 (153.7)	55,240 (245.6)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.75						
	Strength reduction factor for shear ²	ϕ	-	0.65						

¹Values provided for common rod material types based on specified strengths and calculated in accordance with ACI 318-19 Eq. 17.6.1.2 and Eq. 17.7.1.2b. Nuts and washers must comply with requirements for the rod.

²The tabulated value of ϕ applies when the load combinations of Section 1605.1 of the 2024 IBC or ACI 318-19 5.3, as set forth in ACI 318-19 17.5.3 are used.

TABLE 5—CONCRETE BREAKOUT DESIGN INFORMATION FOR U.S. CUSTOMARY UNIT THREADED ROD¹

DESIGN INFORMATION	Symbol	Units	Nominal Rod Diameter (inch)						
			$\frac{3}{8}$	$\frac{1}{2}$	$\frac{5}{8}$	$\frac{3}{4}$	$\frac{7}{8}$	1	$1\frac{1}{4}$
Effectiveness factor for cracked concrete	$k_{c,cr}$	in-lb (SI)	17 (7)						
Effectiveness factor for uncracked concrete	$k_{c,uncr}$	in-lb (SI)	24 (10)						
Min. anchor spacing	s_{min}	in. (mm)	$1\frac{7}{8}$ (48)	$2\frac{3}{8}$ (60)	3 (76)	$3\frac{3}{4}$ (95)	$4\frac{1}{4}$ (108)	$4\frac{3}{4}$ (121)	$5\frac{7}{8}$ (149)
Min. edge distance	c_{min}	in. (mm)	$1\frac{5}{8}$ (41)	$1\frac{3}{4}$ (44)	2 (51)	$2\frac{3}{8}$ (60)	$2\frac{1}{2}$ (64)	$2\frac{3}{4}$ (70)	$3\frac{1}{4}$ (82)
					See Section 4.1.9 of this report for smaller edge distances with 0.45 T_{max}				
Min. member thickness	h_{min}	in. (mm)	$h_{ef} + 1\frac{1}{4}$ ($h_{ef} + 30$)		$h_{ef} + 2d_o^3$				
Critical edge distance - splitting (for uncracked concrete) ²	c_{ac}	-	See Section 4.1.10 of this report.						
Critical anchor spacing – splitting	s_{ac}	-	$2 \cdot c_{ac}$						
Strength reduction factor for tension, concrete failure modes ²	ϕ	-	0.65						
Strength reduction factor for shear, concrete failure modes ²	ϕ	-	0.70						

For **SI**: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006894 MPa.

For **pound-inch** units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

¹Additional setting information is described in [Figure 5](#), installation instructions.

²The strength reduction factor applies when the load combinations from the IBC or ACI 318 are used and the requirements of ACI 318-19 17.5.3 are met

³ d_o = hole diameter.



VARIOUS AVAILABLE TWO-COMPONENT CARTRIDGES



STATIC MIXING NOZZLE



AEROSMITH FASTENING SYSTEMS DISPENSER

FIGURE 3— AEROSMITH SURE-SET® PURE EPOXY PLUS+ ADHESIVE ANCHOR SYSTEM

TABLE 6—BOND STRENGTH DESIGN INFORMATION FOR U.S. CUSTOMARY UNIT THREADED ROD IN HOLES DRILLED WITH A HAMMER DRILL AND CARBIDE BIT (OR AEROSMITH FASTENING SYSTEMS HOLLOW CARBIDE DRILL BIT)¹

DESIGN INFORMATION			Symbol	Units	Nominal Rod Diameter (inch)						
					3/8	1/2	5/8	3/4	7/8	1	1 1/4
Minimum embedment			$h_{ef,min}$	in. (mm)	2 3/8 (60.3)	2 3/4 (69.9)	3 1/8 (79.4)	3 1/2 (88.9)	3 1/2 (88.9)	4 (101.6)	5 (127.0)
Maximum embedment			$h_{ef,max}$	in. (mm)	7 1/2 (191)	10 (254)	12 1/2 (318)	15 (381)	17 1/2 (445)	20 (508)	25 (635)
Temperature range A ^{2,3}	Characteristic bond strength in uncracked concrete		$T_{k,uncr}$	psi (N/mm ²)	2,200 (15.1)	2,135 (14.7)	2,075 (14.3)	2,010 (13.8)	1,950 (13.4)	1,885 (13.0)	1,760 (12.1)
	Characteristic bond strength in cracked concrete		$T_{k,cr}$	psi (N/mm ²)	1,525 (10.5)	1,535 (10.6)	1,375 (9.4)	1,555 (10.7)	1,530 (10.5)	1,495 (10.3)	1,445 (9.9)
Temperature range B ^{2,3}	Characteristic bond strength in uncracked concrete		$T_{k,uncr}$	psi (N/mm ²)	1,720 (11.8)	1,675 (11.5)	1,625 (11.2)	1,575 (10.8)	1,525 (10.5)	1,480 (10.1)	1,380 (9.5)
	Characteristic bond strength in cracked concrete		$T_{k,cr}$	psi (N/mm ²)	1,195 (8.2)	1,205 (8.3)	1,080 (7.4)	1,215 (8.3)	1,200 (8.2)	1,170 (8.0)	1,135 (7.8)
Temperature range C ^{2,3}	Characteristic bond strength in uncracked concrete		$T_{k,uncr}$	psi (N/mm ²)	970 (6.7)	940 (6.5)	915 (6.3)	885 (6.1)	855 (5.9)	825 (5.7)	770 (5.3)
	Characteristic bond strength in cracked concrete		$T_{k,cr}$	psi (N/mm ²)	665 (4.6)	680 (4.7)	610 (4.2)	680 (4.7)	665 (4.6)	665 (4.6)	640 (4.4)
Permissible installation conditions	Dry concrete	Anchor Category	-	-	1						
		Strength reduction factor	ϕ_d	-	0.65						
	Water-saturated concrete	Anchor Category	-	-	2						
		Strength reduction factor	ϕ_{ws}	-	0.55						
	Water-filled hole (flooded)	Anchor Category	-	-	3						
		Strength reduction factor	ϕ_{wf}	-	0.45						
		Modification factor for Water-filled holes	K_{wf}	-	0.85						
	Underwater (submerged)	Anchor Category	-	-	2						
		Strength reduction factor	ϕ_{uw}	-	0.55						
Reduction factor for seismic tension			$\alpha_{N,seis}$	-	1.00	1.00	0.90	1.00	0.95	1.00	1.00

For **SI**: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006894 MPa.

For **pound-inch** units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

¹Bond strength values correspond to concrete compressive strength $f'_c = 2,500$ psi (17.2 N/mm²). For concrete compressive strength, f'_c between 2,500 (17.2 N/mm²) psi and 8,000 psi (55.2 N/mm²), the tabulated characteristic bond strength may be increased by a factor of $(f'_c / 2500)^{0.21}$ [For SI: $(f'_c / 17.2)^{0.21}$] for uncracked concrete, and $(f'_c / 2500)^{0.14}$ [For SI: $(f'_c / 17.2)^{0.14}$] for cracked concrete. See Section 4.1.4 of this report.

²Temperature range A: Maximum short term temperature = 140°F (60°C), maximum long term temperature = 110°F (43°C); Temperature range B: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 110°F (43°C); Temperature range C: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 140°F (60°C).

Short term elevated concrete temperatures are those that occur over brief intervals, e.g. as result of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.

³Characteristic bond strengths are for sustained loads including dead and live loads. For load combinations consisting of short-term loads only such as wind or seismic, bond strengths may be increased by 17 percent for temperature range A and B and by 92 percent for temperature range C.

**TABLE 7—BOND STRENGTH DESIGN INFORMATION FOR U.S. CUSTOMARY UNIT THREADED ROD IN HOLES
DRILLED WITH A DIAMOND CORE BIT¹**

DESIGN INFORMATION			Symbol	Units	Nominal Rod Diameter (inch)						
					3/8	1/2	5/8	3/4	7/8	1	1 1/4
Minimum embedment			$h_{ef,min}$	in. (mm)	2 3/8 (60.3)	2 3/4 (69.9)	3 1/8 (79.4)	3 1/2 (88.9)	3 1/2 (88.9)	4 (101.6)	5 (127.0)
Maximum embedment			$h_{ef,max}$	in. (mm)	7 1/2 (191)	10 (254)	12 1/2 (318)	15 (381)	17 1/2 (445)	20 (508)	25 (635)
Temperature range A ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	psi (N/mm ²)	1655 (11.4)	1550 (10.7)	1495 (10.3)	1435 (9.9)	1390 (9.6)	1350 (9.3)	1290 (8.9)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	psi (N/mm ²)	1205 (8.3)	1116 (7.7)	1045 (7.2)	1000 (6.9)	970 (6.7)	945 (6.5)	945 (6.5)
Temperature range B ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	psi (N/mm ²)	1350 (9.3)	1275 (8.8)	1220 (8.4)	1160 (8.0)	1130 (7.8)	1100 (7.6)	1045 (7.2)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	psi (N/mm ²)	970 (6.7)	915 (6.3)	855 (5.9)	810 (5.6)	800 (5.5)	770 (5.3)	770 (5.3)
Temperature range C ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	psi (N/mm ²)	970 (6.7)	915 (6.3)	885 (6.1)	840 (5.8)	810 (5.6)	800 (5.5)	755 (5.2)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	psi (N/mm ²)	650 (4.5)	610 (4.2)	580 (4.0)	550 (3.8)	535 (3.7)	520 (3.6)	520 (3.6)
Permissible installation conditions	Dry concrete	Anchor Category	-	-	1						
		Strength reduction factor	ϕ_d	-	0.65						
	Water-saturated concrete	Anchor Category	-	-	1	2	2	2	3	3	3
		Strength reduction factor	ϕ_{ws}	-	0.65	0.55	0.55	0.55	0.45	0.45	0.45
Reduction factor for seismic tension			$\alpha_{N,seis}$	-	1.00	1.00	1.00	0.98	0.99	0.98	1.00

For **SI**: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006894 MPa.

For **pound-inch** units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

¹Bond strength values correspond to concrete compressive strength $f'_c = 2,500$ psi (17.2 N/mm²). For concrete compressive strength, f'_c between 2,500 (17.2 N/mm²) psi and 8,000 psi (55.2 N/mm²), the tabulated characteristic bond strength may be increased by a factor of $(f'_c / 2500)^{0.20}$ [For SI: $(f'_c / 17.2)^{0.20}$] for uncracked concrete, and $(f'_c / 2500)^{0.20}$ [For SI: $(f'_c / 17.2)^{0.20}$] for cracked concrete. See Section 4.1.4 of this report.

²Temperature range A: Maximum short term temperature = 140°F (60°C), maximum long term temperature = 110°F (43°C); Temperature range B: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 110°F (43°C); Temperature range C: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 140°F (60°C).

Short term elevated concrete temperatures are those that occur over brief intervals, e.g. as result of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.

³Characteristic bond strengths are for sustained loads including dead and live loads. For load combinations consisting of short-term loads only such as wind or seismic, bond strengths may be increased by 20 percent for temperature range A and B and by 61 percent for temperature range C.

TABLE 8—STEEL DESIGN INFORMATION FOR U.S. CUSTOMARY UNIT REINFORCING BARS¹

DESIGN INFORMATION		Symbol	Units	Nominal Bar Size							
				No. 3	No. 4	No. 5	No. 6	No. 7	No. 8	No. 9	No. 10
Reinforcing bar O.D.		d_b	in. (mm)	0.375 (9.5)	0.500 (12.7)	0.625 (15.9)	0.750 (19.1)	0.875 (22.2)	1.000 (25.4)	1.128 (28.6)	1.270 (31.8)
Reinforcing bar effective cross-sectional area		A_{se}	in. ² (mm ²)	0.110 (71)	0.200 (129)	0.310 (200)	0.440 (284)	0.600 (387)	0.790 (510)	1.000 (645)	1.270 (819)
ASTM A615, A767 Grade 75	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	11,000 (48.9)	20,000 (89.0)	31,000 (137.9)	44,000 (195.7)	60,000 (266.9)	79,000 (351.4)	100,000 (444.8)	127,000 (564.9)
		V_{sa}	lb (kN)	6,600 (29.4)	12,000 (53.4)	18,600 (82.7)	26,400 (117.4)	36,000 (160.1)	47,400 (210.8)	60,000 (266.9)	76,200 (338.9)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70							
	Strength reduction factor for tension ²	ϕ	-	0.65							
	Strength reduction factor for shear ²	ϕ	-	0.60							
ASTM A615, A767, A996 Grade 60	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	8,800 (39.1)	16,000 (71.2)	24,800 (110.3)	35,200 (156.6)	48,000 (213.5)	63,200 (281.1)	80,000 (355.9)	101,600 (452.0)
		V_{sa}	lb (kN)	5,280 (23.5)	9,600 (42.7)	14,880 (66.2)	21,120 (93.9)	28,800 (128.1)	37,920 (168.7)	48,000 (213.5)	60,960 (271.2)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70							
	Strength reduction factor for tension ²	ϕ	-	0.65							
	Strength reduction factor for shear ²	ϕ	-	0.60							
ASTM A706 Grade 60	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	8,800 (39.1)	16,000 (71.2)	24,800 (110.3)	35,200 (156.6)	48,000 (213.5)	63,200 (281.1)	80,000 (355.9)	101,600 (452.0)
		V_{sa}	lb (kN)	5,280 (23.5)	9,600 (42.7)	14,880 (66.2)	21,120 (93.9)	28,800 (128.1)	37,920 (168.7)	48,000 (213.5)	60,960 (271.2)
	Reduction for seismic shear	$\alpha_{V,seis}$	----	0.70							
	Strength reduction factor ϕ for tension ²	ϕ	----	0.75							
	Strength reduction factor ϕ for shear ²	ϕ	----	0.65							
ASTM A615 Grade 40	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	lb (kN)	6,600 (29.4)	12,000 (53.4)	18,600 (82.7)	26,400 (117.4)	In accordance with ASTM A615, Grade 40 bars are furnished only in sizes No. 3 through No. 6			
		V_{sa}	lb (kN)	3,960 (17.6)	7,200 (32.0)	11,160 (49.6)	15,840 (70.5)				
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70							
	Strength reduction factor for tension ²	ϕ	-	0.65							
	Strength reduction factor for shear ²	ϕ	-	0.60							

For **SI**: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006894 MPa.For **pound-inch** units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.¹Values provided for common bar material types based on specified strengths and calculated in accordance with ACI 318-19 Eq. 17.6.1.2.²The tabulated value of ϕ applies when the load combinations of Section 1605.1 of the 2024 IBC or ACI 318-19 5., as set forth in ACI 318-19 17.5.3 are used.³In accordance with ASTM A615, Grade 40 bars are furnished only in sizes No. 3 through No. 6.

TABLE 9—CONCRETE BREAKOUT DESIGN INFORMATION FOR U.S. CUSTOMARY UNIT REINFORCING BARS¹

DESIGN INFORMATION	Symbol	Units	Nominal Bar Size							
			No. 3	No. 4	No. 5	No. 6	No. 7	No. 8	No. 9	No.10
Effectiveness factor for cracked concrete	$k_{c,cr}$	in.-lb (SI)	17 (7)							
Effectiveness factor for uncracked concrete	$k_{c,uncr}$	in.-lb. (SI)	24 (10)							
Min. anchor spacing	s_{min}	in. (mm)	1 ⁷ / ₈ (48)	2 ³ / ₈ (60)	3 (77)	3 ³ / ₄ (95)	4 ¹ / ₄ (108)	4 ³ / ₄ (121)	5 ¹ / ₄ (135)	5 ⁷ / ₈ (149)
Min. edge spacing ⁴	c_{min}	in. (mm)	1 ⁵ / ₈ (41)	1 ³ / ₄ (44)	2 (51)	2 ³ / ₈ (60)	2 ¹ / ₂ (64)	2 ³ / ₄ (70)	3 (76)	3 ¹ / ₄ (82)
					See Section 4.1.9 of this report for smaller edge distances with 0.45 Tmax					
Min. member thickness	h_{min}	in. (mm)	$h_{ef} + 1^{1}/_4$ ($h_{ef} + 30$)		$h_{ef} + 2d_o$ ³					
Critical edge spacing – splitting (for uncracked concrete) ²	c_{ac}	-	See Section 4.1.10 of this report.							
Critical anchor spacing – splitting	s_{ac}	-	$2 \cdot c_{ac}$							
Strength reduction factor for tension, concrete failure modes ²	ϕ	-	0.65							
Strength reduction factor for shear, concrete failure modes ²	ϕ	-	0.70							

For **SI**: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa.

For **pound-inch** units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

¹Additional setting information is described in [Figure 5](#), installation instructions.

²The strength reduction factor applies when the load combinations from the IBC or ACI 318 are used and the requirements of ACI 318-19 17.5.3 are met.

³ d_o = hole diameter.

**TABLE 10—BOND STRENGTH DESIGN INFORMATION FOR U.S. CUSTOMARY UNIT REINFORCING BARS
IN HOLES DRILLED WITH A HAMMER DRILL AND CARBIDE BIT¹**

DESIGN INFORMATION			Symbol	Units	Nominal Bar Size							
					No. 3	No. 4	No. 5	No. 6	No. 7	No. 8	No. 9	No.10
Minimum embedment			$h_{ef,min}$	in. (mm)	2 ³ / ₈ (60.3)	2 ³ / ₄ (69.9)	3 ¹ / ₈ (79.4)	3 ¹ / ₂ (88.9)	3 ¹ / ₂ (88.9)	4 (101.6)	4 ¹ / ₂ (114)	5 (127.0)
Maximum embedment			$h_{ef,max}$	in. (mm)	7 ¹ / ₂ (191)	10 (254)	12 ¹ / ₂ (318)	15 (381)	17 ¹ / ₂ (445)	20 (508)	22.5 (572)	25 (635)
Temperature range A ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	psi (N/mm ²)	1,945 (13.4)	1,910 (13.1)	1,875 (12.9)	1,845 (12.7)	1,810 (12.4)	1,775 (12.2)	1,705 (11.7)	1,705 (11.7)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	psi (N/mm ²)	1,460 (10.0)	1,460 (10.0)	1,315 (9.0)	1,460 (10.0)	1,460 (10.0)	1,460 (10.0)	1,430 (9.8)	1,430 (9.8)
Temperature range B ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	psi (N/mm ²)	1,525 (10.5)	1,495 (10.3)	1,470 (10.1)	1,445 (9.9)	1,420 (9.7)	1,390 (9.5)	1,330 (9.1)	1,335 (9.2)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	psi (N/mm ²)	1,145 (7.8)	1,145 (7.8)	1,030 (7.1)	1,145 (7.8)	1,145 (7.8)	1,145 (7.8)	1,120 (7.7)	1,120 (7.7)
Temperature range C ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	psi (N/mm ²)	855 (5.9)	840 (5.8)	825 (5.7)	810 (5.6)	795 (5.5)	785 (5.4)	755 (5.2)	755 (5.2)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	psi (N/mm ²)	680 (4.7)	680 (4.7)	680 (4.7)	680 (4.7)	680 (4.7)	680 (4.7)	680 (4.7)	680 (4.7)
Permissible installation conditions	Dry concrete	Anchor Category	-	-	1							
		Strength reduction factor	ϕ_d	-	0.65							
	Water-saturated concrete	Anchor Category	-	-	2							
		Strength reduction factor	ϕ_{ws}	-	0.55							
	Water-filled hole (flooded)	Anchor Category	-	-	3							
		Strength reduction factor	ϕ_{wf}	-	0.45							
		Modification factor for Water-filled holes	K_{wf}	-	0.85							
	Underwater (submerged)	Anchor Category	-	-	2							
		Strength reduction factor	ϕ_{uw}	-	0.55							
Reduction factor for seismic tension			$\alpha_{N,seis}$	-	1.00							

For **SI**: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006894 MPa.

For **pound-inch** units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

¹Bond strength values correspond to concrete compressive strength $f'_c = 2,500$ psi (17.2 N/mm²). For uncracked concrete compressive strength, f'_c between 2,500 psi (17.2 N/mm²) and 8,000 psi (55.2 N/mm²), the tabulated characteristic bond strength may be increased by a factor of $(f'_c / 2500)^{0.18}$ [For SI: $(f'_c / 17.2)^{0.18}$]. See Section 4.1.4 of this report.

²Temperature range A: Maximum short term temperature = 140°F (60°C), maximum long term temperature = 110°F (43°C); Temperature range B: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 110°F (43°C); Temperature range C: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 140°F (60°C).

Short term elevated concrete temperatures are those that occur over brief intervals, e.g. as result of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.

³Characteristic bond strengths are for sustained loads including dead and live loads. For load combinations consisting of short-term loads only such as wind or seismic, bond strengths may be increased by 17 percent for temperature range A and B and by 92 percent for temperature range C.

**TABLE 11—BOND STRENGTH DESIGN INFORMATION FOR U.S. CUSTOMARY UNIT REINFORCING BARS
IN HOLES DRILLED WITH A DIAMOND CORE BIT ¹**

DESIGN INFORMATION		Symbol	Units	Nominal Bar Size							
				No. 3	No. 4	No. 5	No. 6	No. 7	No. 8	No. 9	No. 10
Minimum embedment		$h_{ef,min}$	in. (mm)	2 ³ / ₈ (60.3)	2 ³ / ₄ (69.9)	3 ¹ / ₈ (79.4)	3 ¹ / ₂ (88.9)	3 ¹ / ₂ (88.9)	4 (101.6)	4 ¹ / ₂ (114)	5 (127.0)
Maximum embedment		$h_{ef,max}$	in. (mm)	7 ¹ / ₂ (191)	10 (254)	12 ¹ / ₂ (318)	15 (381)	17 ¹ / ₂ (445)	20 (508)	22.5 (572)	25 (635)
Temperature range A ^{2,3}	Characteristic bond strength in uncracked concrete	$\tau_{k,uncr}$	psi (N/mm ²)	1480 (10.2)	1465 (10.1)	1350 (9.3)	1350 (9.3)	1350 (9.3)	1350 (9.3)	1350 (9.3)	1350 (9.3)
Temperature range B ^{2,3}	Characteristic bond strength in uncracked concrete	$\tau_{k,uncr}$	psi (N/mm ²)	1205 (8.3)	1205 (8.3)	1100 (7.6)	1100 (7.6)	1100 (7.6)	1100 (7.6)	1100 (7.6)	1100 (7.6)
Temperature range C ^{2,3}	Characteristic bond strength in uncracked concrete	$\tau_{k,uncr}$	psi (N/mm ²)	870 (6.0)	870 (6.0)	800 (5.5)	800 (5.5)	800 (5.5)	800 (5.5)	800 (5.5)	800 (5.5)
Permissible installation conditions	Dry concrete	Anchor Category	-	-	1						
		Strength reduction factor	ϕ_d	-	0.65						
	Water-saturated concrete	Anchor Category	-	-	1	2	2	2	3	3	3
		Strength reduction factor	ϕ_{ws}	-	0.65	0.55	0.55	0.55	0.45	0.45	0.45

For **SI**: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006894 MPa.

For **pound-inch** units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

¹Bond strength values correspond to concrete compressive strength $f'_c = 2,500$ psi (17.2 N/mm²). For compressive strength, f'_c between 2,500 psi (17.2 N/mm²) and 8,000 psi (55.2 N/mm²), the tabulated characteristic bond strength may be increased by a factor of $(f'_c / 2500)^{0.35}$ [For SI: $(f'_c / 17.2)^{0.35}$]. See Section 4.1.4 of this report.

²Temperature range A: Maximum short term temperature = 140°F (60°C), maximum long term temperature = 110°F (43°C); Temperature range B: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 110°F (43°C); Temperature range C: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 140°F (60°C).

Short term elevated concrete temperatures are those that occur over brief intervals, e.g. as result of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.

³Characteristic bond strengths are for sustained loads including dead and live loads. For load combinations consisting of short-term loads only such as wind or seismic, bond strengths may be increased by 20 percent for temperature range A and B and by 61 percent for temperature range C.

TABLE 12—STEEL DESIGN INFORMATION FOR METRIC THREADED ROD¹

DESIGN INFORMATION		Symbol	Units	Nominal Rod Diameter (mm)						
				M10	M12	M16	M20	M24	M27	M30
Threaded rod O.D.		d_a	mm (in.)	10 (0.39)	12 (0.47)	16 (0.63)	20 (0.79)	24 (0.94)	27 (1.06)	30 (1.18)
Threaded rod effective cross-sectional area		A_{se}	mm ² (in. ²)	58.0 (0.090)	84.3 (0.131)	157 (0.243)	245 (0.380)	353 (0.547)	459 (0.711)	561 (0.870)
ISO 898-1 Class 5.8	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	kN (lb)	29.0 (6,518)	42.2 (9,473)	78.5 (17,643)	122.5 (27,532)	176.5 (39,668)	229.5 (51,580)	280.5 (63,043)
		V_{sa}	kN (lb)	14.5 (3,260)	25.3 (5,684)	47.1 (10,586)	73.5 (16,519)	105.9 (23,801)	137.7 (30,948)	168.3 (37,826)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.65						
	Strength reduction factor for shear ²	ϕ	-	0.60						
ISO 898-1 Class 8.8	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	kN (lb)	46.4 (10,428)	67.4 (15,157)	125.6 (28,229)	196 (44,051)	282.4 (63,470)	367.2 (82,528)	448.8 (100,868)
		V_{sa}	kN (lb)	23.0 (5,216)	40.5 (9,094)	75.4 (16,937)	117.6 (26,431)	169.4 (38,082)	220.3 (49,517)	269.3 (60,521)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.65						
	Strength reduction factor for shear ²	ϕ	-	0.60						
ISO 3506-1, A4 stainless steel ³	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	kN (lb)	40.6 (9,125)	59 (13,263)	109.9 (24,700)	171.5 (38,545)	247.1 (55,536)	229.5 (51,580)	280.5 (63,043)
		V_{sa}	kN (lb)	20.3 (4,564)	35.4 (7,958)	65.9 (14,820)	102.9 (23,127)	148.3 (33,322)	137.7 (30,948)	168.3 (37,826)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70						
	Strength reduction factor for tension ²	ϕ	-	0.65						
	Strength reduction factor for shear ²	ϕ	-	0.60						

¹Values provided for common rod material types based on specified strengths and calculated in accordance with ACI 318-19 Eq. 17.6.1.2 and Eq. 17.7.1.2b. Nuts and washers must comply with requirements for the rod.

²The tabulated value of ϕ applies when the load combinations of Section 1605.1 of the 2024 IBC or ACI 318-19 5.3 as set forth in ACI 318-19 17.5.3 are used.

³A4-70 Stainless steel (M8-M24); A4-50 Stainless steel (M27-M30).

TABLE 13—CONCRETE BREAKOUT DESIGN INFORMATION FOR METRIC THREADED ROD¹

DESIGN INFORMATION	Symbol	Units	Nominal Rod Diameter (mm)						
			M10	M12	M16	M20	M24	M27	M30
Effectiveness factor for cracked concrete	$k_{c,cr}$	SI (in-lb)	7 (17)						
Effectiveness factor for uncracked concrete	$k_{c,uncr}$	SI (in-lb)	10 (24)						
Min. anchor spacing	s_{min}	mm (in.)	50 (2)	60 (2 ³ / ₈)	80 (3 ¹ / ₈)	95 (3 ³ / ₄)	115 (4 ¹ / ₂)	130 (5 ¹ / ₈)	145 (5 ¹ / ₂)
Min. edge distance	c_{min}	mm (in.)	40 (1 ⁵ / ₈)	45 (1 ³ / ₄)	55 (2 ¹ / ₄)	60 (2 ³ / ₈)	70 (2 ³ / ₄)	75 (3)	80 (3 ¹ / ₈)
					See Section 4.1.9 of this report for smaller edge distance with 0.45 T_{max}				
Min. member thickness	h_{min}	mm (in.)	$h_{ef} + 30$ ($h_{ef} + 1\frac{1}{4}$)		$h_{ef} + 2d_o^3$				
Critical edge distance – splitting (for uncracked concrete) ²	c_{ac}	-	See Section 4.1.10 of this report.						
Strength reduction factor for tension, concrete failure modes ²	ϕ	-	0.65						
Strength reduction factor for shear, concrete failure modes ²	ϕ	-	0.70						

¹Additional setting information is described in [Figure 5](#), installation instructions.

²The strength reduction factor applies when the load combinations from the IBC or ACI 318 are used and the requirements of ACI 318-19 17.5.3 are met.

³ d_o = hole diameter.

TABLE 14—BOND STRENGTH DESIGN INFORMATION FOR METRIC THREADED ROD IN HOLES DRILLED WITH A HAMMER DRILL AND CARBIDE BIT (OR AEROSMITH FASTENING SYSTEMS AEROSMITH FASTENING SYSTEMS HOLLOW CARBIDE DRILL BIT)¹

DESIGN INFORMATION			Symbol	Units	Nominal Rod Diameter (inch)						
					M10	M12	M16	M20	M24	M27	M30
Minimum embedment			$h_{ef,min}$	mm (in.)	60 (2.4)	70 (2.8)	80 (3.1)	90 (3.5)	96 (3.8)	108 (4.3)	120 (4.7)
Maximum embedment			$h_{ef,max}$	mm (in.)	200 (7.8)	240 (14.8)	320 (12.6)	400 (15.8)	480 (18.8)	540 (21.4)	600 (23.6)
Temperature range A ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	N/mm ² (psi)	15.0 (2,190)	14.8 (2,150)	14.2 (2,070)	13.7 (1,995)	13.2 (1,915)	12.7 (1,855)	12.3 (1,795)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	N/mm ² (psi)	10.5 (1,525)	10.6 (1,540)	9.4 (1,375)	10.7 (1,555)	10.5 (1,535)	10.3 (1,495)	9.9 (1,450)
Temperature range B ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	N/mm ² (psi)	11.8 (1,715)	11.6 (1,685)	11.1 (1,625)	10.7 (1,560)	10.3 (1,500)	10.0 (1,453)	9.7 (1,405)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	N/mm ² (psi)	8.2 (1,195)	8.3 (1,205)	7.4 (1,080)	8.3 (1,215)	8.2 (1,200)	8.0 (1,170)	7.8 (1,135)
Temperature range C ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	N/mm ² (psi)	6.7 (970)	6.4 (930)	6.0 (870)	5.8 (840)	5.5 (800)	5.4 (785)	5.3 (770)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	N/mm ² (psi)	4.5 (650)	4.2 (610)	4.0 (580)	3.8 (550)	3.7 (535)	3.6 (520)	3.6 (520)
Permissible installation conditions	Dry Concrete	Anchor category	—	-	1						
		Strength reduction factor	ϕ_d	-	0.65						
	Water-saturated Concrete	Anchor category	—	-	2						
		Strength reduction factor	ϕ_{ws}	-	0.55						
	Water-filled hole (flooded)	Anchor category	—	-	3						
		Strength reduction factor	ϕ_{wf}	-	0.45						
		Modification factor for water filled holes	K_{wf}	-	0.85						
	Underwater (submerged)	Anchor Category	-	-	2						
		Strength reduction factor	ϕ_{uw}	-	0.55						
Reduction factor for seismic tension			$\alpha_{N,seis}$	-	1.00	1.00	0.90	0.94	0.94	1.00	1.00

¹Bond strength values correspond to concrete compressive strength $f'_c = 2,500$ psi (17.2 N/mm²). For concrete compressive strength, f'_c between 2,500 psi (17.2 N/mm²) and 8,000 psi (55.2 N/mm²), the tabulated characteristic bond strength may be increased by a factor of $(f'_c / 2500)^{0.21}$ [For SI: $(f'_c / 17.2)^{0.21}$] for uncracked concrete and $(f'_c / 2500)^{0.14}$ [For SI: $(f'_c / 17.2)^{0.14}$] for cracked concrete. See Section 4.1.4 of this report.

²Temperature range A: Maximum short term temperature = 140°F (60°C), maximum long term temperature = 110°F (43°C); Temperature range B: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 110°F (43°C); Temperature range C: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 140°F (60°C).

Short term elevated concrete temperatures are those that occur over brief intervals, e.g. as result of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.

³Characteristic bond strengths are for sustained loads including dead and live loads. For load combinations consisting of short-term loads only such as wind or seismic, bond strengths may be increased by 17 percent for temperature range A and B and by 92 percent for temperature range C.

TABLE 15—STEEL DESIGN INFORMATION FOR EU METRIC AND CANADIAN METRIC REINFORCING BARS¹

DESIGN INFORMATION		Symbol	Units	Nominal Bar Size (EU)							
				Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	Ø 28	Ø 32
Reinforcing bar O.D.		d_b	mm (in.)	10 (0.394)	12 (0.472)	14 (0.551)	16 (0.630)	20 (0.787)	25 (0.984)	28 (1.102)	32 (1.260)
Reinforcing bar effective cross-sectional area		A_{se}	mm ² (in. ²)	78.5 (0.121)	113.1 (0.175)	153.9 (0.239)	201.1 (0.312)	314.2 (0.487)	490.9 (0.761)	615.8 (0.954)	804.2 (1.247)
DIN 488 BSt 500	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	kN (lb)	43.2 (9,739)	62.2 (14,024)	84.7 (19,088)	110.6 (24,932)	172.8 (38,956)	270.0 (60,868)	338.7 (76,353)	442.3 (99,727)
		V_{sa}	kN (lb)	25.9 (5,843)	37.3 (8,414)	50.8 (11,453)	66.4 (14,959)	103.7 (23,373)	162.0 (36,521)	203.2 (45,812)	265.4 (59,836)
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70							
	Strength reduction factor for tension ²	ϕ	-	0.65							
	Strength reduction factor for shear ²	ϕ	-	0.60							
DESIGN INFORMATION		Symbol	Units	Nominal Bar Size (Canadian)							
				10M	15M	20M	25M	30M			
Reinforcing bar O.D.		d_b	mm (in.)	11.3 (0.445)	16.0 (0.630)	19.5 (0.768)	25.2 (0.992)	29.9 (1.177)			
Reinforcing bar effective cross-sectional area		A_{se}	mm ² (in. ²)	100.3 (0.155)	201.1 (0.312)	298.6 (0.463)	498.8 (0.773)	702.2 (1.088)			
CAN/CSA G30.18	Nominal strength as governed by steel strength (for a single anchor)	N_{sa}	kN (lb)	54.0 (12,175)	108.5 (24,410)	161.5 (36,255)	270.0 (60,550)	380.0 (85,240)			
		V_{sa}	kN (lb)	32.5 (7,305)	65.0 (14,645)	97.0 (21,755)	161.5 (36,330)	227.5 (51,145)			
	Reduction factor for seismic shear	$\alpha_{V,seis}$	-	0.70							
	Strength reduction factor for tension ²	ϕ	-	0.65							
	Strength reduction factor for shear ²	ϕ	-	0.60							

¹Values provided for common bar material types based on specified strengths and calculated in accordance with ACI 318-19 Eq. 17.6.1.2 and Eq. 17.7.1.2b.²The tabulated value of ϕ applies when the load combinations of Section 1605.1 of the 2024 IBC or ACI 318-19 5.3 as set forth in ACI 318-19 17.5.3 are used.TABLE 16—CONCRETE BREAKOUT DESIGN INFORMATION FOR EU AND CANADIAN METRIC REINFORCING BARS¹

DESIGN INFORMATION	Symbol	Units	Nominal Bar Size													
			Ø 10	10M	Ø 12	Ø 14	15M	Ø 16	Ø 20	20M	Ø 25	25M	Ø 28	30M	Ø 32	
Effectiveness factor for cracked concrete	$k_{c,cr}$	SI (in-lb)	7 (17)													
Effectiveness factor for uncracked concrete	$k_{c,uncr}$	SI (in-lb)	10 (24)													
Min. anchor spacing	s_{min}	mm (in.)	50 (2)	55 (2 ¹ / ₈)	60 (2 ³ / ₈)	70 (2 ³ / ₄)	75 (3)	80 (3 ¹ / ₈)	95 (3 ³ / ₄)	95 (3 ³ / ₄)	120 (4 ⁵ / ₈)	120 (4 ⁵ / ₈)	135 (5 ¹ / ₄)	140 (5 ¹ / ₂)	150 (5 ⁷ / ₈)	
Min. edge spacing	c_{min}	mm (in.)	40 (1 ⁵ / ₈)	45 (1 ³ / ₄)	45 (1 ³ / ₄)	50 (2)	50 (2)	55 (2 ¹ / ₄)	60 (2 ³ / ₈)	60 (2 ³ / ₈)	70 (2 ³ / ₄)	70 (2 ³ / ₄)	75 (3)	80 (3 ¹ / ₈)	85 (3 ¹ / ₈)	
						See Section 4.1.9 of this report for smaller edge distances with 0.45 T_{max}										
Min. member thickness	h_{min}	mm (in.)	$h_{ef} + 30$ ($h_{ef} + 1\frac{1}{4}$)				$h_{ef} + 2d_o^3$									
Critical edge spacing – splitting (for uncracked concrete) ²	c_{ac}	-	See Section 4.1.10 of this report.													
Strength reduction factor for tension, concrete failure modes ²	ϕ	-	0.65													
Strength reduction factor for shear, concrete failure modes ²	ϕ	-	0.70													

¹Additional setting information is described in Figure 5, installation instructions.²The strength reduction factor applies when the load combinations from the IBC or ACI 318 are used and the requirements of ACI 318-19 17.5.3 are met.³ d_o = hole diameter.

TABLE 17—BOND STRENGTH DESIGN INFORMATION EU METRIC REINFORCING BARS IN HOLES DRILLED WITH A HAMMER DRILL AND CARBIDE BIT (OR AEROSMITH FASTENING SYSTEMS HOLLOW CARBIDE DRILL BIT)¹

DESIGN INFORMATION			Symbol	Units	Nominal Bar Size (EU)							
					Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	Ø 28	Ø 32
Minimum embedment			$h_{ef,min}$	mm. (in.)	60 (2.4)	70 (2.8)	75 (3.0)	80 (3.1)	90 (3.5)	100 (3.9)	112 (4.4)	128 (5.0)
Maximum embedment			$h_{ef,max}$	mm (in.)	200 (7.9)	240 (9.4)	280 (11.0)	320 (12.6)	400 (15.7)	500 (19.7)	560 (22.0)	640 (25.2)
Temperature range A ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	N/mm ² (psi)	13.3 (1,940)	13.2 (1,920)	13.0 (1,895)	12.8 (1,855)	12.5 (1,815)	12.2 (1,775)	12.0 (1,745)	11.7 (1,705)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	N/mm ² (psi)	10.0 (1,460)	10.0 (1,460)	10.0 (1,460)	9.0 (1,315)	10.0 (1,460)	10.0 (1,460)	9.8 (1,430)	9.8 (1,430)
Temperature range B ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	N/mm ² (psi)	10.4 (1,520)	10.3 (1,505)	10.2 (1,485)	10.0 (1,455)	9.7 (1,420)	9.5 (1,390)	9.4 (1,365)	9.2 (1,335)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	N/mm ² (psi)	7.8 (1,145)	7.8 (1,145)	7.8 (1,145)	7.1 (1,030)	7.8 (1,145)	7.8 (1,145)	7.7 (1,120)	7.7 (1,120)
Temperature range C ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	N/mm ² (psi)	5.9 (855)	5.8 (840)	5.7 (825)	5.6 (810)	5.5 (795)	5.4 (785)	5.3 (770)	5.2 (755)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	N/mm ² (psi)	4.7 (680)	4.7 (680)	4.7 (680)	4.7 (680)	4.7 (680)	4.7 (680)	4.7 (680)	4.7 (680)
Permissible installation conditions	Dry Concrete	Anchor category	—	-	1							
		Strength reduction factor	ϕ_d	-	0.65							
	Water-saturated Concrete	Anchor category	—	-	2							
		Strength reduction factor	ϕ_{ws}	-	0.55							
	Water-filled hole (flooded)	Anchor category	—	-	3							
		Strength reduction factor	ϕ_{wf}	-	0.45							
		Modification factor for water filled holes	K_{wf}	-	0.85							
	Underwater (submerged)	Anchor Category	-	-	2							
Strength reduction factor		ϕ_{uw}	-	0.55								
Reduction factor for seismic tension			$\alpha_{N,seis}$	-	1.0							

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006894 MPa.

For pound-inch units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

¹Bond strength values correspond to concrete compressive strength $f'_c = 2,500$ psi (17.2 N/mm²). For uncracked concrete compressive strength, f'_c between 2,500 psi (17.2 N/mm²) and 8,000 psi (55.2 N/mm²), the tabulated characteristic bond strength may be increased by a factor of $(f'_c / 2500)^{0.18}$ [For SI: $(f'_c / 17.2)^{0.18}$]. See Section 4.1.4 of this report.

²Temperature range A: Maximum short term temperature = 140°F (60°C), maximum long term temperature = 110°F (43°C); Temperature range B: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 110°F (43°C); Temperature range C: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 140°F (60°C).

Short term elevated concrete temperatures are those that occur over brief intervals, e.g. as result of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.

³Characteristic bond strengths are for sustained loads including dead and live loads. For load combinations consisting of short-term loads only such as wind or seismic, bond strengths may be increased by 17 percent for temperature range A and B and by 92 percent for temperature range C.

TABLE 18—BOND STRENGTH DESIGN INFORMATION METRIC CANADIAN REINFORCING BARS IN HOLES DRILLED WITH A HAMMER DRILL AND CARBIDE BIT (OR AEROSMITH FASTENING SYSTEMS HOLLOW CARBIDE DRILL BIT)¹

DESIGN INFORMATION			Symbol	Units	Nominal Rod Diameter (CA)				
					10M	15M	20M	25M	30M
Minimum embedment			$h_{ef,min}$	mm. (in.)	60 (2.4)	80 (3.1)	90 (3.5)	100 (3.9)	120 (4.7)
Maximum embedment			$h_{ef,max}$	mm (in.)	200 (7.9)	300 (11.8)	400 (15.7)	500 (19.7)	600 (23.6)
Temperature range A ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	N/mm ² (psi)	12.7 (1,850)	12.2 (1,780)	12.0 (1,745)	11.8 (1,720)	11.4 (1,665)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	N/mm ² (psi)	9.0 (1,305)	7.9 (1,155)	8.6 (1,253)	8.4 (1,225)	8.1 (1,175)
Temperature range B ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	N/mm ² (psi)	9.9 (1,450)	9.6 (1,395)	9.4 (1,370)	9.2 (1,350)	8.9 (1,300)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	N/mm ² (psi)	7.0 (1,020)	6.2 (905)	6.7 (980)	6.6 (960)	6.3 (920)
Temperat ure range C ^{2,3}	Characteristic bond strength in uncracked concrete		$\tau_{k,uncr}$	N/mm ² (psi)	5.6 (810)	5.5 (795)	5.4 (785)	5.2 (755)	5.1 (740)
	Characteristic bond strength in cracked concrete		$\tau_{k,cr}$	N/mm ² (psi)	4.2 (610)	4.1 (595)	4.0 (580)	4.0 (580)	4.0 (580)
Permissible installation conditions	Dry Concrete	Anchor category	—	-	1				
		Strength reduction factor	ϕ_d	-	0.65				
	Water-saturated Concrete	Anchor category	—	-	2				
		Strength reduction factor	ϕ_{ws}	-	0.55				
	Water-filled hole (flooded)	Anchor category	—	-	3				
		Strength reduction factor	ϕ_{wf}	-	0.45				
		Modification factor for water filled holes	K_{wlf}	-	0.85				
	Underwater (submerged)	Anchor Category	-	-	2				
Strength reduction factor		ϕ_{uw}	-	0.55					
Reduction factor for seismic tension			$\alpha_{N,seis}$	-	1.0				

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006894 MPa.

For pound-inch units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

¹Bond strength values correspond to concrete compressive strength $f'_c = 2,500$ psi (17.2 N/mm²). For uncracked concrete compressive strength, f'_c between 2,500 psi (17.2 N/mm²) and 8,000 psi (55.2 N/mm²), the tabulated characteristic bond strength may be increased by a factor of $(f'_c / 2500)^{0.08}$ [For SI: $(f'_c / 17.2)^{0.08}$] for uncracked concrete and $(f'_c / 2500)^{0.09}$ [For SI: $(f'_c / 17.2)^{0.09}$] for cracked concrete. See Section 4.1.4 of this report.

² Temperature range A: Maximum short term temperature = 140°F (60°C), maximum long term temperature = 110°F (43°C); Temperature range B: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 110°F (43°C); Temperature range C: Maximum short term temperature = 176°F (80°C), maximum long term temperature = 140°F (60°C).

Short term elevated concrete temperatures are those that occur over brief intervals, e.g. as result of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.

³Characteristic bond strengths are for sustained loads including dead and live loads. For load combinations consisting of short-term loads only such as wind or seismic, bond strengths may be increased by 17 percent for temperature range A and B and by 92 percent for temperature range C.

TABLE 19—DEVELOPMENT LENGTH FOR U.S. CUSTOMARY UNIT REINFORCING BARS IN HOLES DRILLED WITH A HAMMER DRILL AND CARBIDE BIT (OR AEROSMITH FASTENING SYSTEMS HOLLOW CARBIDE DRILL BIT) OR DIAMOND CORE BIT^{1,2,4,5,6}

DESIGN INFORMATION	Symbol	Criteria Section of Reference Standard	Units	Bar size								
				#3	#4	#5	#6	#7	#8	#9	#10	#11
Nominal reinforcing bar diameter	d_b	ASTM A615/A706 Grade 60	in.	0.375	0.500	0.625	0.750	0.875	1.000	1.128	1.270	1.410
			(mm)	(9.5)	(12.7)	(15.9)	(19.1)	(22.2)	(25.4)	(28.7)	(32.3)	(35.8)
Nominal bar area	A_b	ASTM A615/A706 Grade 60	in ²	0.11	0.20	0.31	0.44	0.60	0.79	1.00	1.27	1.56
			(mm ²)	(71)	(129)	(199)	(284)	(387)	(510)	(645)	(819)	(1006)
Development length for $f_y = 60$ ksi and $f'_c = 2,500$ psi (normal weight concrete) ³	l_d	ACI 318-19 25.4.2.4	in.	12.0	14.4	18.0	21.6	31.5	36.0	40.6	45.7	50.8
			(mm)	(305)	(366)	(457)	(549)	(800)	(914)	(1031)	(1161)	(1289)
Development length for $f_y = 60$ ksi and $f'_c = 3,000$ psi (normal weight concrete) ³	l_d		in.	12.0	13.1	16.4	19.7	28.8	32.9	37.1	41.7	46.3
			(mm)	(305)	(334)	(417)	(501)	(730)	(835)	(942)	(1060)	(1177)
Development length for $f_y = 60$ ksi and $f'_c = 4,000$ psi (normal weight concrete) ³	l_d		in.	12.0	12.0	14.2	17.1	24.9	28.5	32.1	36.1	40.1
			(mm)	(305)	(305)	(361)	(434)	(633)	(723)	(815)	(918)	(1019)
Development length for $f_y = 60$ ksi and $f'_c = 6,000$ psi (normal weight concrete) ³	l_d		in.	12.0	12.0	12.0	13.9	20.3	23.2	26.2	29.5	32.8
			(mm)	(305)	(305)	(305)	(354)	(516)	(590)	(666)	(750)	(832)
Development length for $f_y = 60$ ksi and $f'_c = 8,000$ psi (normal weight concrete) ³	l_d		in.	12.0	12.0	12.0	12.1	17.6	20.1	22.7	25.6	28.4
			(mm)	(305)	(305)	(305)	(307)	(447)	(511)	(577)	(649)	(721)

For SI: 1 inch $\equiv$ 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa.

For pound-inch units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi

¹ Development lengths valid for static, wind, and earthquake loads (SDC A and B).

² Development lengths in SDC C through F must comply with ACI 318-19 Chapter 18 and section 4.2.4 of this report.

³ f_y and f'_c used in this table are for example purposes only. For sand-lightweight concrete, increase development length by 33%, unless the provisions of ACI 318-19 25.4.2.5 are met to permit $\lambda > 0.75$.

$$^4 \left(\frac{c_b + K_{tr}}{d_b} \right) = 2.5, \quad \psi_t = 1.0, \quad \psi_e = 1.0, \quad \psi_s = 0.8 \text{ for } d_b \leq \#6, \quad 1.0 \text{ for } d_b > \#6.$$

⁵ Calculations may be performed for other steel grades per ACI 318-19 Chapter 25.

⁶ Minimum development length shall not be less than 12 in (305 mm) per ACI-19 Section 25.4.2.1

TABLE 20—DEVELOPMENT LENGTH FOR EU METRIC REINFORCING BARS IN HOLES DRILLED WITH A HAMMER DRILL AND CARBIDE BIT (OR AEROSMITH FASTENING SYSTEMS HOLLOW CARBIDE DRILL BIT) OR DIAMOND CORE BIT^{1,2,4,5,6}

DESIGN INFORMATION	Symbol	Criteria Section of Reference Standard	Units	Bar size							
				φ 10	φ 12	φ 16	φ 20	φ 25	φ 28	φ 32	φ 36
Nominal reinforcing bar diameter	d_b	DIN 488, BSt 500 (BS 4449:2005)	mm	10	12	16	20	25	28	32	36
			(in.)	(0.394)	(0.472)	(0.630)	(0.787)	(0.984)	(1.102)	(1.260)	(1.417)
Nominal bar area	A_b		mm ²	79	113	201	314	491	616	804	1018
			(in. ²)	(0.12)	(0.18)	(0.31)	(0.49)	(0.76)	(0.95)	(1.25)	(1.58)
Development length for $f_y = 72.5$ ksi and $f'_c = 2,500$ psi (normal weight concrete) ³	l_d	ACI 318-19 25.4.2.4 ⁷	mm	348	418	557	870	1088	1218	1392	1566
			(in.)	(13.7)	(16.4)	(21.9)	(34.3)	(42.8)	(48.0)	(54.8)	(61.7)
Development length for $f_y = 72.5$ ksi and $f'_c = 3,000$ psi (normal weight concrete) ³	l_d		mm	318	381	508	794	993	1112	1271	1430
			(in.)	(12.5)	(15.0)	(20.0)	(31.3)	(39.1)	(43.8)	(50.0)	(56.3)
Development length for $f_y = 72.5$ ksi and $f'_c = 4,000$ psi (normal weight concrete) ³	l_d		mm	305	330	440	688	860	963	1100	1238
			(in.)	12.0	13.0	17.3	27.1	33.8	37.9	43.3	48.7
Development length for $f_y = 72.5$ ksi and $f'_c = 6000$ psi (normal weight concrete) ³	l_d		mm	305	305	359	562	702	786	899	1011
			(in.)	(12.0)	(12.0)	(14.2)	(22.1)	(27.6)	(31.0)	(35.4)	(39.8)
Development length for $f_y = 72.5$ ksi and $f'_c = 8000$ psi (normal weight concrete) ³	l_d		mm	305	305	311	486	608	681	778	875
			(in.)	(12.0)	(12.0)	(12.3)	(19.1)	(23.9)	(26.8)	(30.6)	(34.5)

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa.

For pound-inch units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi

¹Development lengths valid for static, wind, and earthquake loads (SDC A and B).

²Development lengths in SDC C through F must comply with ACI 318-19 Chapter 18 and section 4.2.4 of this report.

³ f_y and f'_c used in this table are for example purposes only. For sand-lightweight concrete, increase development length by 33%, unless the provisions of ACI 318-19 25.4.2.5 are met to permit $\lambda > 0.75$.

$$^4 \left(\frac{c_b + K_{tr}}{d_b} \right) = 2.5, \psi_t = 1.0, \psi_e = 1.0, \psi_s = 0.8 \text{ for } d_b < 20\text{mm}, 1.0 \text{ for } d_b \geq 20\text{mm}.$$

⁵ Calculations may be performed for other steel grades per ACI 318-19 Chapter 25.

⁶ Minimum development length shall not be less than 12 in (305 mm) per ACI-19 Section 25.4.2.1

⁷ l_d must be increased by 9.5% to account for ψ_g in ACI 318-19 25.4.2.4. ψ_g has been interpolated from Table 25.4.2.5 of ACI 318-19 for $f_y = 72.5$ ksi.

TABLE 21—DEVELOPMENT LENGTH FOR CA METRIC REINFORCING BARS IN HOLES DRILLED WITH A HAMMER DRILL AND CARBIDE BIT (OR AEROSMITH FASTENING SYSTEMS HOLLOW CARBIDE DRILL BIT) OR DIAMOND CORE BIT^{1,2,4,5,6}

DESIGN INFORMATION	Symbol	Criteria Section of Reference Standard	Units	Bar size					
				10M	15M	20M	25M	30M	35M
Nominal reinforcing bar diameter	d_b	CAN/CSA G30.18 Grade 400	mm	11.3	16.0	19.5	25.2	29.9	35.7
			(in.)	(0.445)	(0.630)	(0.768)	(0.992)	(1.177)	(1.406)
Nominal bar area	A_b		mm ²	100	200	300	500	700	1000
			(in ²)	(0.16)	(0.31)	(0.46)	(0.77)	(1.09)	(1.56)
Development length for $f_y = 58$ ksi and $f_c = 2,500$ psi (normal weight concrete) ³	l_d	ACI 318-19 25.4.2.4 ⁷	mm	315	446	679	877	1041	1243
			(in.)	(12.4)	(17.5)	(26.7)	(34.5)	(41.0)	(48.9)
Development length for $f_y = 58$ ksi and $f_c = 3,000$ psi (normal weight concrete) ³	l_d		mm	305	407	620	801	950	1134
			(in.)	(12.0)	(16.0)	(24.4)	(31.5)	(37.4)	(44.7)
Development length for $f_y = 58$ ksi and $f_c = 4,000$ psi (normal weight concrete) ³	l_d		mm	305	352	537	693	823	982
			(in.)	(12.0)	(13.9)	(21.1)	(27.3)	(32.4)	(38.7)
Development length for $f_y = 58$ ksi and $f_c = 6000$ psi (normal weight concrete) ³	l_d		mm	305	305	438	566	672	802
			(in.)	(12.0)	(12.0)	(17.2)	(22.3)	(26.4)	(31.6)
Development length for $f_y = 58$ ksi and $f_c = 8000$ psi (normal weight concrete) ³	l_d		mm	305	305	379	490	582	695
			(in.)	(12.0)	(12.0)	(14.9)	(19.3)	(22.9)	(27.3)

For SI: 1 inch $\equiv$ 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa.

For pound-inch units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi

¹Development lengths valid for static, wind, and earthquake loads (SDC A and B).

²Development lengths in SDC C through F must comply with ACI 318-19 Chapter 18 and section 4.2.4 of this report.


³ f_y and f_c used in this table are for example purposes only. For sand-lightweight concrete, increase development length by 33%, unless the provisions of ACI 318-19 25.4.2.5 are met to permit $\lambda > 0.75$.

⁴ $\left(\frac{c_b + K_{tr}}{d_b}\right) = 2.5$, $\psi_t = 1.0$, $\psi_e = 1.0$, $\psi_s = 0.8$ for $d_b < 20$ mm, 1.0 for $d_b \geq 20$ mm.

⁵Calculations may be performed for other steel grades per ACI 318-19 Chapter 25.

⁶Minimum development length shall not be less than 12 in (305 mm) per ACI-19 Section 25.4.2.1

⁷ l_d must be increased by 9.5% to account for ψ_g in ACI 318-19 25.4.2.4. ψ_g has been interpolated from Table 25.4.2.5 of ACI 318-19 for $f_y = 72.5$ ksi.

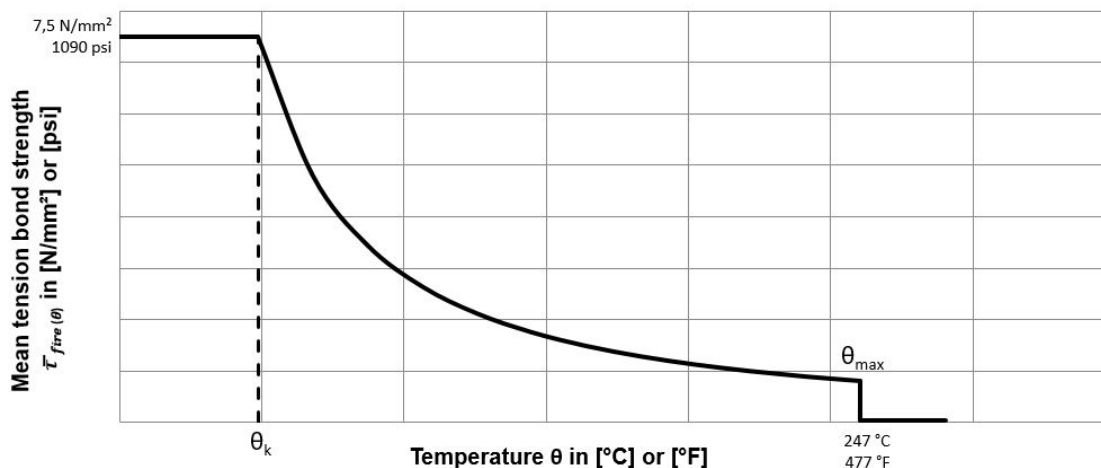

The mean tension bond strength $\bar{\tau}_{fire}(\theta)$ under fire conditions shall be determined in accordance with the following equations:

For hammer drill and carbide bit (or Aerosmith Fastening Systems hollow carbide bit):

$$\begin{aligned}\bar{\tau}_{fire}(\theta) &= 1955671 \cdot \theta^{-1.585} \leq 1090 \text{ [psi]} \text{ with } \theta \text{ in } ^\circ\text{F} \\ \bar{\tau}_{fire}(\theta) &= 1277 \cdot \theta^{-1.341} \leq 7.5 \text{ [N/mm}^2\text{]} \text{ with } \theta \text{ in } ^\circ\text{C} \\ \theta_k &= 113^\circ\text{F (46}^\circ\text{C)}\end{aligned}$$

For diamond core bit:

$$\begin{aligned}\bar{\tau}_{fire}(\theta) &= 1814842 \cdot \theta^{-1.585} \leq 1090 \text{ [psi]} \text{ with } \theta \text{ in } ^\circ\text{F} \\ \bar{\tau}_{fire}(\theta) &= 1185 \cdot \theta^{-1.341} \leq 7.5 \text{ [N/mm}^2\text{]} \text{ with } \theta \text{ in } ^\circ\text{C} \\ \theta_k &= 108^\circ\text{F (44}^\circ\text{C)}\end{aligned}$$

¹ With $\theta_{max} = 247^\circ\text{C (477}^\circ\text{F)}$. For temperatures larger than θ_{max} the bond strength $\bar{\tau}_{fire}(\theta) = 0$.

² For application with rebar #11 (36mm) or larger for overhead installation, bond strengths must be decreased by 11 percent.

³Bond strengths under fire are for short-term loads such as wind and seismic loads, and for sustained loads in diamond drilled holes at long term temperatures of 110°F (43°C) or less, and for sustained loads in hammer drilled holes at long term temperatures of 140°F (60°C) or less. For sustained loads in diamond drilled holes at long term temperature between 110°F (43°C) and 140°F (60°C), bond strengths must be decreased by 10 percent.

FIGURE 4— BOND STRENGTH VS TEMPERATURE FOR POST INSTALLED REINFORCING BAR APPLICATIONS SUBJECT TO ELEVATED TEMPERATURE / FIRE IN HOLES DRILLED WITH HAMMER DRILL AND CARBIDE BIT (OR AEROSMITH FASTENING SYSTEMS HOLLOW CARBIDE DRILL BIT) OR DIAMOND CORE BIT^{1,2,3}

TABLE 22— APPLICABLE SECTIONS OF THE IBC CODE UNDER EACH EDITION OF THE IBC

2024 IBC	2021 IBC	2018 IBC	2015 IBC
Section 1605.1		Section 1605.2 or 1605.3	
Section 1705.1.1			
Table 1705.3			
Section 1705			
Section 1706			
Section 1707			
Chapter 19			
Section 1901.3			
Section 1903			
Section 1905			
Section 1905.7	Section 1905.1.8		

TABLE 23— APPLICABLE SECTIONS OF ACI 318 UNDER EACH EDITION OF THE IBC

2024 IBC	2021 IBC	2018 IBC	2015 IBC
ACI 318-19		ACI 318-14	
2.3		2.3	
5.3		5.3	
Chapter 17		Chapter 17	
17.2.4		17.2.6	
17.3.1		17.2.7	
17.5.1.2		17.3.1	
17.5.2		17.3.1.1	
17.5.3		17.3.3	
17.6.1.2		17.4.1.2	
17.6.2		17.4.2	
17.6.2.2		17.4.2.2	
17.6.2.5		17.4.2.6	
17.6.5		17.4.5	
17.6.5.1.2b		17.4.1.5d	
17.6.5.2.1		17.4.5.2	
17.6.5.5		17.4.5.5	
Eq. 17.6.5.5.1b		Eq. 17.4.5.5b	
Eq. 17.6.5.5.1c		Eq. 17.4.5.5c	
17.7.1.2		17.5.1.2	
17.7.2		17.5.2	
17.7.2.2		17.5.2.2	
17.7.3		17.5.3	
17.8		17.6	
17.8.2 and 17.8.3		17.6.1, 17.6.2 and 17.6.3	
17.9.2		17.7.1 and 17.7.3	
17.9.3		17.7.4	
17.9.5		17.7.6	
17.10		17.2.3	
Chapter 18		Chapter 18	
Chapter 19		Chapter 19	
Chapter 25		Chapter 25	
25.4.2.5		25.4.2.4	
26.6.3.2 (b)		26.6.3.1 (b)	
26.7.2		17.8.1 and 17.8.2	
26.7.1(l) and 26.7.2(e)		17.8.2.2 or 17.8.2.3	
26.13.3.2(e)		17.8.2.4, 26.7.1(h) and 26.13.3.2(c)	



PE-10 & 21 Plus+ Installation Card

1. Setting instructions for solid base material with Hammer drilling or Aerosmith hollow drill bit system - ESR-XXXX

Preparing

3 Check adhesive expiration date on cartridge label. Do not use expired product. Review Safety Data Sheet (SDS) before use. For the permitted range of the base material and cartridge temperature see Table 2. Attach a supplied mixing nozzle to the cartridge. Do not modify the mixer in any way and make sure the mixing element is inside the nozzle. Load the cartridge into the correct dispensing tool.

Note: Always use a new mixing nozzle with new cartridges of adhesive and also for all work interruptions exceeding the published gel (working) time of the adhesive.

4 Prior to inserting the anchor rod or rebar into the filled drilled hole, the position of the embedment depth has to be marked on the anchor. Verify anchor element is straight and free of surface damage.

Hole cleaning

UWC: Cleaning (submerged) for all bore hole diameter in uncracked and cracked concrete

2a Starting from the bottom or back of the bore hole, insert/flush the hole clean until clean water comes out. If the back of the drilled hole is not reached an extension shall be used.

2b Determine brush diameter (see Table 3) for the drilled hole. Brush the hole with the selected wire brushes a minimum of two times (2x). A brush extension (supplied by Aerosmith Fastening) must be used for drill hole depth > 6" (150mm). The wire brush diameter must be checked periodically during use ($d_{brush} > d_{hole}$, see Table 3a or 3b). The brush should resist insertion into the drilled hole - if not the brush is too small and must be replaced with the proper brush diameter. If the back of the drilled hole is not reached a brush extension shall be used.

2c Finally blow the hole clean again with compressed air (min. 6 bar / 90 psi) a minimum of two times, until return air stream is free of noticeable dust. If the back of the drilled hole is not reached an extension shall be used. When finished the hole should be clean and free of dust, debris, ice, grease, oil or other foreign material.

Drilling

CAC: Cleaning (dry, water saturated and water-filled) for all bore hole diameter in uncracked and cracked

2a Starting from the bottom or back of the anchor hole, blow the hole clean with compressed air (min. 6 bar / 90 psi) a minimum of two times, until return air stream is free of noticeable dust. If the back of the drilled hole is not reached an extension shall be used.

2b Determine brush diameter (see Table 3) for the drilled hole. Brush the hole with the selected wire brushes a minimum of two times (2x). A brush extension (supplied by Aerosmith Fastening) must be used for drill hole depth > 6" (150mm). The wire brush diameter must be checked periodically during use ($d_{brush} > d_{hole}$, see Table 3a or 3b). The brush should resist insertion into the drilled hole - if not the brush is too small and must be replaced with the proper brush diameter. If the back of the drilled hole is not reached a brush extension shall be used.

2c Finally blow the hole clean again with compressed air (min. 6 bar / 90 psi) a minimum of two times, until return air stream is free of noticeable dust. If the back of the drilled hole is not reached an extension shall be used. When finished the hole should be clean and free of dust, debris, ice, grease, oil or other foreign material.

Precaution: Wear suitable eye and skin protection. Avoid inhalation of dusts during drilling and/or removal. (see dust extraction equipment by Aerosmith to minimize dust emissions)

1 Drill a hole into the base material with a hammer drill tool to the size and embedment required by the selected steel hardware element (see Table 4). The tolerances of the carbide drill bit must meet the requirements of ANSI Standard B212.15.

For bore holes drilled with the Aerosmith hollow drill bit system (consisting of Heiler Duster Expert drill bits and a Class M vacuum with air flow 1.50m³/h resp. 42.5 resp. 90cfm), the vacuum must be on! no further cleaning is required → go to Step 3, otherwise to Step 2a for CAC hole cleaning instructions.

In case of standing water in the drilled hole, except for submerged concrete, all the water has to be removed from the hole (e.g. vacuum, compressed air, etc.) prior to cleaning.

2. Working and curing times

Temperature of base material	Maximum working time	Initial curing time ¹⁾	Full curing time
41 °F (+5 °C) to 49 °F (+9 °C)	80 min	24 h	48 h
50 °F (+10 °C) to 58 °F (+14 °C)	60 min	15 h	30 h
59 °F (+15 °C) to 67 °F (+19 °C)	40 min	10 h	20 h
68 °F (+20 °C) to 76 °F (+24 °C)	30 min	5 h	11 h
77 °F (+25 °C) to 85 °F (+29 °C)	12 min	4 h	9 h
86 °F (+30 °C) to 103 °F (+39 °C)	8 min	3 h	6 h
104 °F (+40 °C)	7 min	2 h	4 h

Cartridge temperature must be between 41°F (+5°C) and 104°F (+40°C)

¹⁾ Initial cure times are for post-installed rebar applications only. After the initial curing time, the installation of connecting reinforcements and formwork attachments is permitted.

Curing and fixture

5 Adhesive must be properly mixed to achieve published properties. Prior to dispensing adhesive into the drilled hole, separately dispense at least three full strokes of adhesive through the mixing nozzle until the adhesive is a consistent gray or red color. Review and note the published working and cure times (see Table 2) prior to injection of the mixed adhesive into the cleaned anchor hole.

6 Fill the cleaned hole approximately two-thirds full with mixed adhesive starting from the bottom or back of the anchor hole. Slowly withdraw the mixing nozzle as the hole fills to avoid creating air pockets or voids. If the bottom or back of the anchor hole is not reached with the mixing nozzle only an extension tube supplied by Aerosmith Anchoring Fastening (Cat# DT10 or DT28) must be used with the mixing nozzle. In case of using the extension tube VL16/1.8 (Cat# MN10), cut the tip of the mixer nozzle at position "X".

7 Piston plugs (see Table 3a or 3b) must be used with and attached to mixing nozzle and extension tube for:

- overhead installations and installations between horizontal and overhead
- all installations with drill hole depth $d_h > 10"$ (250mm)
- all installations in submerged concrete

with anchor rod 5/8" to 1-1/4" (M16 to M30) and rebar sizes #5 to #14 (14 to 36).

8 Insert piston plug to the back of the drilled hole and inject as described in the method above. During installation the piston plug will be naturally extruded from the drilled hole by the adhesive pressure. **Attention:** Do not install anchors overhead or upwardly inclined without installation hardware supplied by Aerosmith and also receiving proper training and/or certification. Contact Aerosmith for details prior to use.

9 The anchor should be free of dirt, grease, oil or other foreign material. Push clean threaded rod or reinforcing bar into the anchor hole while turning slightly to ensure positive distribution of the adhesive until the embedment depth is reached. Observe the gel (working) time.

10 Be sure that the anchor is fully seated at the bottom of the hole and that some adhesive has flowed from the hole and all around the top of the anchor. If there is not enough adhesive in the hole, the installation must be repeated. For overhead applications and applications between horizontal and overhead the anchor must be secured from moving/falling during the cure time (e.g. wedges). Minor adjustments to the anchor may be performed during the gel time but the anchor shall not be moved after placement and during cure.

9 Allow the adhesive anchor to cure to the specified minimum curing time prior to applying any load (see Table 2). Do not disturb, torque or load the anchor until it is fully cured.

10 After full curing of the adhesive anchor, a fixture can be installed to the anchor and tightened up to the maximum torque (shown in Table 4) by using a calibrated torque wrench. Take care not to exceed the maximum torque for the selected anchor.

FIGURE 5—INSTALLATION INSTRUCTIONS

PE-10 & 21 Plus+ Installation Card

1. Setting instructions for solid base material with Diamond drilling - ESR-XXXX
















Preparing	Hole cleaning	Drilling
 3 Check adhesive expiration date on cartridge label. Do not use expired product. Review Safety Data Sheet (SDS) before use. For the permitted range of the base material and cartridge temperature see Table 2. Attach a supplied mixing nozzle to the cartridge. Do not modify the mixer in any way and make sure the mixing element is inside the nozzle. Load the cartridge into the correct dispensing tool. Note Always use a new mixing nozzle with new cartridges of adhesive and also for all work interruptions exceeding the published gel (working) time of the adhesive.	 2a Starting from the bottom or back of the bore hole, rinse/flush the hole clean until clean water comes out. If the back of the drilled hole is not reached an extension shall be used.  2b Determine brush diameter (see Table 3) for the drilled hole. Brush the hole with the selected wire brushes a minimum of two times (2x). A brush extension (supplied by Aerosmith Fastening) must be used for drill hole depth > 6" (150mm). The wire brush diameter must be checked periodically during use (d_brush > d_hole, see Table 3a or 3b). The brush should resist insertion into the drilled hole - if not the brush is too small and must be replaced with the proper brush diameter. If the back of the drilled hole is not reached a brush extension shall be used.  2c Finally, starting from the bottom or back of the bore hole, rinse/flush the hole clean until clean water comes out. If the back of the drilled hole is not reached an extension shall be used.  2d Starting from the bottom or back of the anchor hole, blow the hole clean with compressed air (min. 6 bar / 90 psi) a minimum of two times, until return air stream is free of noticeable dust. If the back of the drilled hole is not reached an extension shall be used.  2e Determine brush diameter (see Table 3) for the drilled hole. Brush the hole with the selected wire brushes a minimum of two times (2x). A brush extension (supplied by Aerosmith Fastening) must be used for drill hole depth > 6" (150mm). The wire brush diameter must be checked periodically during use (d_brush > d_hole, see Table 3a or 3b). The brush should resist insertion into the drilled hole - if not the brush is too small and must be replaced with the proper brush diameter. If the back of the drilled hole is not reached a brush extension shall be used.  2f Finally blow the hole clean again with compressed air (min. 6 bar / 90 psi) a minimum of two times, until return air stream is free of noticeable dust. If the back of the drilled hole is not reached an extension shall be used. When finished the hole should be clean and free of dust, debris, ice, grease, oil or other foreign material.	 1 Drill a hole into the base material with a diamond drill tool to the size and embedment required by the selected steel hardware element (see Table 4). Precaution: Wear suitable eye and skin protection. Avoid inhalation of dusts during drilling and/or removal. (see dust extraction equipment by Aerosmith to minimize dust emissions) In case of standing water in the drilled hole, all the water has to be removed from the hole (e.g. vacuum, compressed air, etc.) prior to cleaning. SPC/CAC: Cleaning for all bore hole diameter in uncracked concrete
Curing and fixture	Installation	Preparing
 10 After full curing of the adhesive anchor, a fixture can be installed to the anchor and tightened up to the maximum torque (shown in Table 4) by using a calibrated torque wrench. Take care not to exceed the maximum torque for the selected anchor.	 7 The anchor should be free of dirt, grease, oil or other foreign material. Push clean threaded rod or reinforcing bar into the anchor hole while turning slightly to ensure positive distribution of the adhesive until the embedment depth is reached. Observe the gel (working) time.  8 Be sure that the anchor is fully seated at the bottom of the hole and that some adhesive has flowed from the hole and all around the top of the anchor. If there is not enough adhesive in the hole, the installation must be repeated. For overhead applications and applications between horizontal and overhead the anchor must be secured from moving/falling during the cure time (e.g. wedges). Minor adjustments to the anchor may be performed during the gel time but the anchor shall not be moved after placement and during cure.  9 Allow the adhesive anchor to cure to the specified minimum curing time prior to applying any load (see Table 2). Do not disturb, torque or load the anchor until it is fully cured.  6 Fill the cleaned hole approximately two-thirds full with mixed adhesive starting from the bottom or back of the anchor hole. Slowly withdraw the mixing nozzle as the hole fills to avoid creating air pockets or voids. If the bottom or back of the anchor hole is not reached with the mixing nozzle only an extension tube supplied by Aerosmith Fastening (Cat# DT10 or Cat# DT28) must be used with the mixing nozzle.  5 Adhesive must be properly mixed to achieve published properties. Prior to dispensing adhesive into the drilled hole, separately dispense at least three full strokes of adhesive through the mixing nozzle until the adhesive is a consistent gray or red color. Review and note the published working and cure times (see Table 2) prior to injection of the mixed adhesive into the cleaned anchor hole.  4 Prior to inserting the anchor rod or rebar into the filled drilled hole, the position of the embedment depth has to be marked on the anchor. Verify anchor element is straight and free of surface damage.	 5 Adhesive must be properly mixed to achieve published properties. Prior to dispensing adhesive into the drilled hole, separately dispense at least three full strokes of adhesive through the mixing nozzle until the adhesive is a consistent gray or red color. Review and note the published working and cure times (see Table 2) prior to injection of the mixed adhesive into the cleaned anchor hole.

FIGURE 5—INSTALLATION INSTRUCTIONS (Continued)

							
Threaded Rod [inch]	Rebar [inch]	d ₀ Drill bit - Ø [inch]	d _b Brush - Ø [mm] [inch]	d _{b,min} min Brush - Ø [mm] [inch]	Cat. # Piston plug (No.)	Cat. # [I]	
3/8"	-	7/16	13.5 [0.53]	11.6 [0.46]	716Brush		
1/2"	-	1/2	14.3 [0.56]	13.2 [0.52]	716Brush	No plugs required	
-	-	9/16	16.3 [0.65]	14.8 [0.58]	917Brush		
-	#4	5/8	18.3 [0.72]	16.5 [0.65]	917Brush		
5/8"	-	1 1/16	20.0 [0.79]	18.0 [0.71]	1116Brush		
s	#5	3/4	21.5 [0.85]	19.5 [0.78]	1116Brush		
3/4"	#6	7/8	24.8 [0.98]	23.0 [0.91]	788Brush	3/4	40341
7/8"	#7	1	28.5 [1.12]	26.2 [1.03]	348Brush	7/8	40343
1"	#8	1 1/8	31.8 [1.25]	29.5 [1.16]	18Brush	1	ET916
1-1/4"	#9	1 3/8	38.2 [1.50]	35.8 [1.41]	138Brush	1 1/8	40346
-	#10	1 1/2	41.4 [1.63]	39.0 [1.54]	138Brush	1 1/2	40350
-	#11	1 3/4	47.0 [1.85]	45.0 [1.77]	138Brush	1 3/4	40352



4. Anchor property / Setting information (fractional and metric sizes)

Nominal threaded rod (fractional sizes)										Nominal threaded rod (metric sizes)									
Anchor size										mm; Nm									
d_c = Nominal anchor rod diameter	d_c [inch]	d_c [mm]	d_c [inch]	d_c [mm]	d_c [inch]	d_c [mm]	d_c [inch]	d_c [mm]	d_c [inch]	#3	#4	#5	#6	#7	#8	#9	#10	#11	#12
d_c (d ₀) = Nominal ANSI drill bit size	3/8"	1/2"	5/8"	3/4"	7/8"	1"	1 1/4"	M10	M12	M16	M20	M24	M27	M30	23	27	30	35	38
T_{max} = Maximum torque	200	30	44	66	96	147	221	20	40	80	120	170	250	300	200	230	270	300	350
$h_{ef,min}$ = Minimum embedment	2-3/8"	2-3/4"	3-1/8"	3-1/2"	3-1/2"	4"	5"	60	70	80	90	96	108	120	2-3/8"	2-3/4"	3-1/2"	3-1/2"	4"
$h_{ef,max}$ = Maximum embedment	7-1/2"	10"	12-1/2"	15"	17-1/2"	20"	25"	200	240	320	400	480	540	600	7-1/2"	10"	12-1/2"	15"	17-1/2"
S_{min} = Min. spacing	1-7/8"	2-1/2"	3"	3-3/4"	4-1/4"	5-7/8"	5-7/8"	50	60	80	95	115	130	145	1-7/8"	2-1/2"	3"	3-3/4"	4-1/4"
C_{min} = Min. edge distance (100% T_{max})	1-5/8"	1-3/4"	2"	2-3/8"	2-1/2"	2-3/4"	3-1/4"	40	45	55	60	70	75	80	1-5/8"	1-3/4"	2"	2-3/8"	2-1/2"
h_{min} = Minimum member thickness	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$	$h_{ef} + 1-1/4"$

$h_{ef,min}$ = Minimum embedment
 $h_{ef,max}$ = Maximum embedment (PIR)
 S_{min} = 5x d_c
 C_{min} = 3x d_c
 h_{ef} = 15 ft.-lb.

5. PE10/21-Plus+ adhesive anchor system and accessories

Injection tools	Cartridge system	Extra mixing nozzles	Piston Plug	Compressed air nozzle	Extension tube	Extension with wood handle
9.5 fl. oz. dispenser	Cat. #DT10 Manual tool	PE10-Plus+ 9.5 fl. oz. (280mL)			VL10/0.75	
13.5 fl. oz. dispenser	Cat. #DT13 Manual tool	PE13-Plus+			(Cat. #ET38)	(Cat. #716brush)
20 to 20.5 fl. oz. dispenser	Cat. #DT22 Manual tool	PE21-Plus+ 20 to 20.5 fl. oz. (600 to 610 mL)			Extension tube VL16/1.8	Brush extension
50.5 fl. oz. dispensers	Cat. #DT50 Manual tool	PE50-Plus+	(Cat. # Table 3a or 3b)	If the bore hole ground is not reached an extension shall be used.	(Cat. #ET916)	(Cat. #s12brush)



3b. Parameter cleaning and setting tools (metric sizes – EU + CA)

									
Threaded Rod [mm]	Rebar [mm]	CA [inch]	d ₀ Drill bit - Ø EU [mm]	CA [inch]	d ₀ Brush - Ø [mm]	min. Brush - Ø [mm]	Cat. # [I]	Piston plug (No.)	Cat. # [I]
M10	-	-	12	-	13.5	0.53	16111	No plugs required	
M12	10	10M	14	9/16	15.5	0.61	16113		
-	12	-	16	-	17.5	0.69	16115		
M16	14	-	18	-	20.0	0.79	16117		
-	-	15M	-	3/4	21.5	0.85	16118		
-	16	-	20	-	22.0	0.73	16119		
M20	-	22	22	-	24.0	0.94	16120		
-	20	25	25	-	27.0	1.06	16122		
-	-	20M	-	1	28.5	1.12	16123		
M24	-	-	28	-	30.0	1.18	16124		
M27	-	-	30	-	31.8	1.25	16125		
-	25	25M	32	1-1/4	34.0	1.34	32 / 1-1/4"		
M30	28	-	35	-	37.0	1.46	16126		
-	-	30M	-	1 1/2	41.4	1.63	35		
-	32	-	40	-	43.5	1.71	16129		
-	-	35M	-	1 3/4	47.0	1.85	40		
-	36	-	45	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-	-	-	47.0	1.85	16080		
-	-	-							

ICC-ES Evaluation Report

ESR-5901 City of LA Supplement

Issued February 2026

This report is subject to renewal February 2027.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 03 00 00—CONCRETE
Section: 03 16 00—Concrete Anchors

DIVISION: 05 00 00—METALS
Section: 05 05 19—Post-Installed Concrete Anchors

REPORT HOLDER:

AEROSMITH FASTENING SYSTEMS

EVALUATION SUBJECT:

AEROSMITH SURE-SET® PURE EPOXY PLUS+ ADHESIVE ANCHOR AND POST-INSTALLED REINFORCING BAR CONNECTION SYSTEM IN CRACKED AND UNCRACKED CONCRETE

1.0 REPORT PURPOSE AND SCOPE

Purpose:

The purpose of this evaluation report supplement is to indicate Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor and Post-Installed Reinforcing Bar Connection System in Cracked and Uncracked Concrete, described in ICC-ES evaluation report [ESR-5901](#), have also been evaluated for compliance with the codes noted below as adopted by the Los Angeles Department of Building and Safety (LADBS).

Applicable code editions:

- 2023 City of Los Angeles Building Code ([LABC](#))
- 2023 City of Los Angeles Residential Code ([LARC](#))

2.0 CONCLUSIONS

The Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor and Post-Installed Reinforcing Bar Connection System in Cracked and Uncracked Concrete, described in Sections 2.0 through 7.0 of the evaluation report [ESR-5901](#), complies with the LABC Chapter 19, and the LARC, and are subject to the conditions of use described in this supplement.

3.0 CONDITIONS OF USE

The Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor System in Cracked and Uncracked Concrete described in this evaluation report must comply with all of the following conditions:

- All applicable sections in the evaluation report [ESR-5901](#).
- The design, installation, conditions of use and identification of the anchors are in accordance with the 2021 *International Building Code*® (IBC) provisions noted in the evaluation report [ESR-5901](#).
- The design, installation and inspection are in accordance with additional requirements of LABC Chapters 16 and 17, as applicable.
- Under the LARC, an engineered design in accordance with LARC Section R301.1.3 must be submitted.
- The design strength values listed in the evaluation report and tables are for the connection of the anchors or post installed reinforcing bars to the concrete. The connection between the anchors or post installed reinforcing bars and the connected members shall be checked for capacity (which may govern).
- For use in wall anchorage assemblies to flexible diaphragms, anchors shall be designed per the requirements of City of Los Angeles Information Bulletin P/BC 2023-071.

This supplement expires concurrently with the evaluation report, issued February 2026.

ICC-ES Evaluation Report

ESR-5901 CA Supplement

Issued February 2026

This report is subject to renewal February 2027.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 03 00 00—CONCRETE

Section: 03 16 00—Concrete Anchors

DIVISION: 05 00 00—METALS

Section: Section: 05 05 19—Post-Installed Concrete Anchors

REPORT HOLDER:

AEROSMITH FASTENING SYSTEMS

EVALUATION SUBJECT:

AEROSMITH SURE-SET® PURE EPOXY PLUS+ ADHESIVE ANCHOR AND POST-INSTALLED REINFORCING BAR CONNECTION SYSTEM IN CRACKED AND UNCRACKED CONCRETE

1.0 REPORT PURPOSE AND SCOPE

Purpose:

The purpose of this evaluation report supplement is to indicate that Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor and Post-Installed Reinforcing Bar Connection System in Cracked and Uncracked Concrete, described in ICC-ES evaluation report [ESR-5901](#), have also been evaluated for compliance with the codes noted below.

Applicable code edition(s):

- 2022 *California Building Code* (CBC)

For evaluation of applicable Chapters adopted by the California Office of Statewide Health Planning and Development (OSHPD) AKA: California Department of Health Care Access and Information (HCAI) and the Division of State Architect (DSA), see Sections 2.1.1 and 2.1.2 below.

- 2022 *California Residential Code* (CRC)

2.0 CONCLUSIONS

2.1 CBC:

The Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor and Post-Installed Reinforcing Bar Connection System in Cracked and Uncracked Concrete described in Sections 2.0 through 7.0 of the evaluation report [ESR-5901](#), comply with CBC Chapters 16, 17 and 19 provided the design and installation are in accordance with the 2021 *International Building Code*® (IBC) provisions noted in the evaluation report and the additional requirements of CBC Chapters 16, 17 and 19 as applicable.

2.1.1 OSHPD:

The applicable OSHPD Sections and Chapters of the CBC are beyond the scope of this supplement.

2.1.2 DSA:

The applicable DSA Sections and Chapters of the CBC are beyond the scope of this supplement.

2.2 CRC:

The Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor and Post-Installed Reinforcing Bar Connection System in Cracked and Uncracked Concrete, described in Sections 2.0 through 7.0 of the evaluation report [ESR-5901](#), comply with CRC Section R301.1.3, provided the design and installation are in accordance with the 2021 *International Residential Code*® (IRC) provisions noted in the evaluation report and the additional requirements of CRC Section R301.1.3.

This supplement expires concurrently with the evaluation report, issued February 2026.

DIVISION: 03 00 00—CONCRETE
Section: 03 16 00—Concrete Anchors

DIVISION: 05 00 00—METALS
Section: 05 05 19—Post-Installed Concrete Anchors

REPORT HOLDER:**AEROSMITH FASTENING SYSTEMS****EVALUATION SUBJECT:****AEROSMITH SURE-SET® PURE EPOXY PLUS+ ADHESIVE ANCHOR AND POST-INSTALLED REINFORCING BAR CONNECTION SYSTEM IN CRACKED AND UNCRACKED CONCRETE****1.0 REPORT PURPOSE AND EVALUATION SCOPE****Purpose:**

The purpose of this evaluation report supplement is to indicate that Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor and Post-Installed Reinforcing Bar Connection System in Cracked and Uncracked Concrete, recognized in ICC-ES evaluation report [ESR-5901](#), has also been evaluated for compliance with the codes noted below.

Compliance with the following codes:

- 2023 Florida Building Code—Building
- 2023 Florida Building Code—Residential

2.0 PURPOSE OF THIS SUPPLEMENT

The Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor and Post-Installed Reinforcing Bar Connection System in Cracked and Uncracked Concrete, described in Sections 2.0 through 7.0 of the evaluation report [ESR-5901](#), complies with the *Florida Building Code—Building* and the *Florida Building Code—Residential*, as applicable, provided the design requirements are determined in accordance with the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable. The installation requirements noted in ICC-ES evaluation report [ESR-5901](#) for the 2021 *International Building Code*® meet the requirements of the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable.

Use of the Aerosmith Sure-Set® Pure Epoxy Plus+ Adhesive Anchor and Post-Installed Reinforcing Bar Connection System in Cracked and Uncracked Concrete has also been found to be in compliance with the High-Velocity Hurricane Zone provision of the *Florida Building Code—Building* and the *Florida Building Code—Residential* with the following condition.

- a) For connections subject to uplift, the connection must be designed for no less than 700 pounds (3114 N).

For products falling under Florida Rule 61G20-3, verification that the report holder's quality assurance program is audited by a quality assurance entity approved by the Florida Building Commission for the type of inspections being conducted is the responsibility of an approved validation entity (or the code official when the report holder does not possess an approval by the Commission). Florida Rule 61G20-3 is applicable to products and/or systems which comprise the building envelope and structural frame for compliance with the structural requirements of the Florida Building Code.

This supplement expires concurrently with the evaluation report, issued February 2026.